

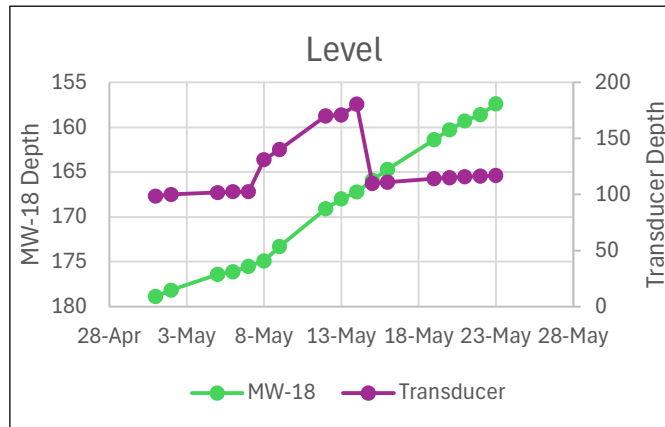


Schwartzwalder Daily Summary Report

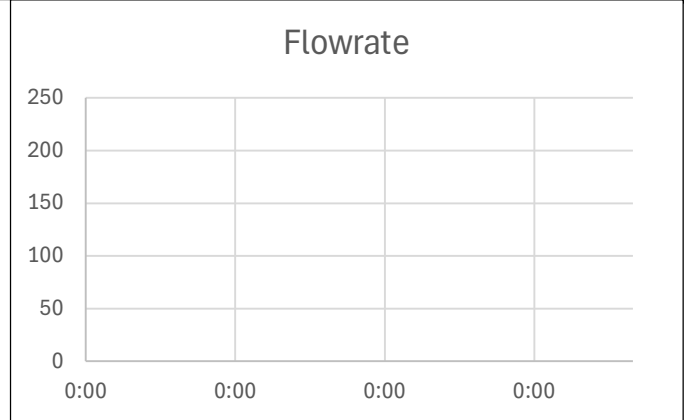

Report Date:	5/23/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.000 Mgal	MW-18 Level:	157 ft
Average Flowrate:	0 gpm	Transducer Level:	117 ft
Effluent to Date:	0.000 Mgal		

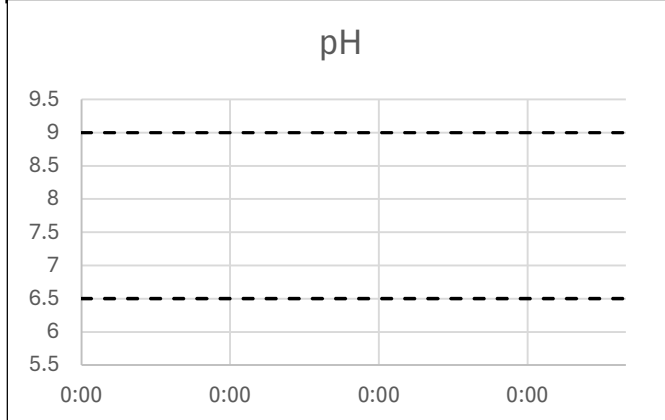

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	NA	NA	NA
Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	NA	NA	NA
Vol. Remaining	NA	NA	NA
Vol. Staged	5500 Gal	644 Gal	325 Gal
Days Available	#VALUE!	#VALUE!	#VALUE!

Safety Issues/Concerns:
- N/A

Notes:
- Cleaned and sorted the lab coolers in the plant.