

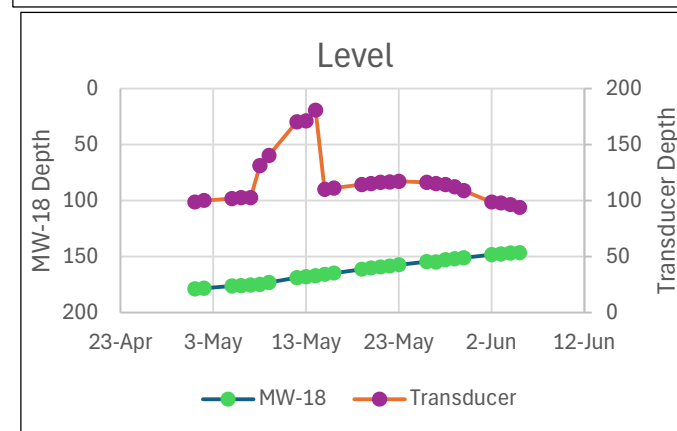


Schwartzwalder Daily Summary Report

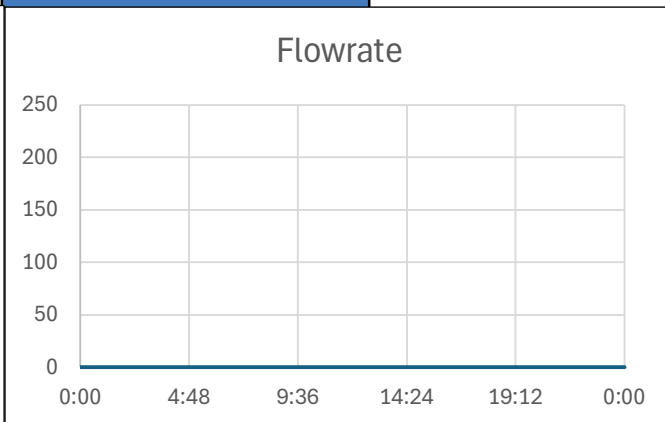

Report Date:	6/5/2025	Lead Operator:	Patrick D
		Assistant Operator(s):	Bryant A

Effluent Discharged:	0.000 Mgal	MW-18 Level:	147 ft
Average Flowrate:	0 gpm	Transducer Level:	94 ft
Effluent to Date:	0.000 Mgal		

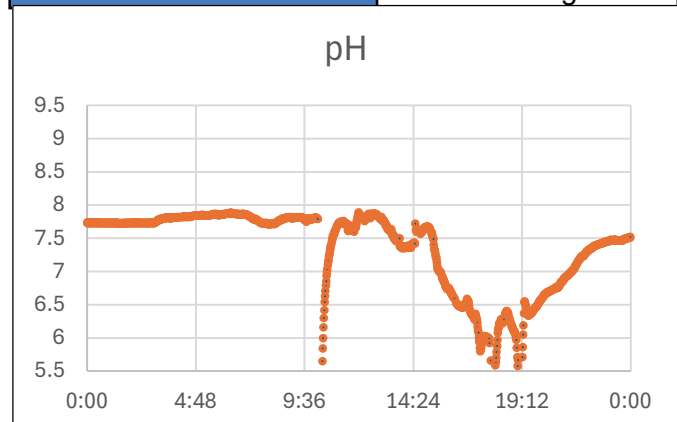

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	17°C	7.62	66 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	NA	NA	NA
Vol. Remaining	230 Gal	96 Gal	50 Gal
Vol. Staged	485 Gal	550 Gal	270 Gal
Days Available	#VALUE!	#VALUE!	#VALUE!

Safety Issues/Concerns:

- N/A

Notes:

- Patrick Delaney onsite.
- Peter Hays & Alex Schwiebert onsite.
- Installed and calibrated new electrode in pH probe for the Finished Water tank.
- Started Plant up at 8:45 am.
- Started Discharging at 10 am.
- Time 15:30. Plant is running smooth. Numbers are looking great within operating parameters. No issues to report.