

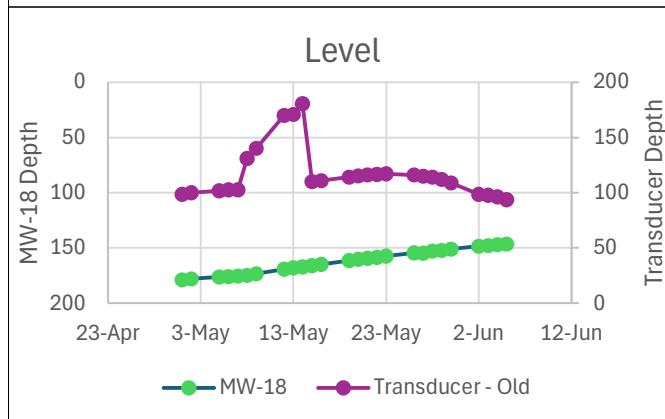


Schwartzwalder Daily Summary Report

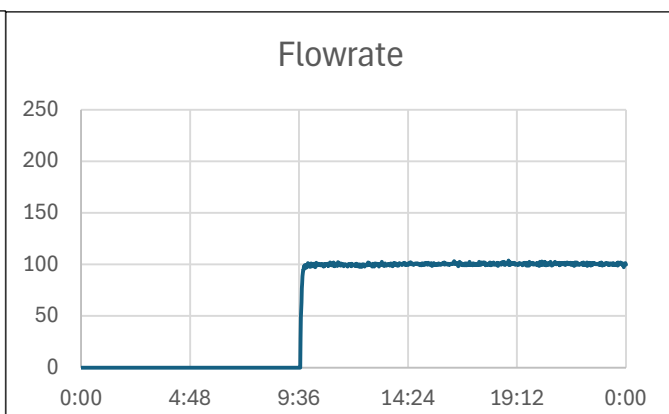

Report Date:	6/5/2025	Lead Operator:	Patrick D
		Assistant Operator(s):	Bryant A Alex S
Effluent Discharged:	0.080 Mgal	MW-18 Level:	147 ft
Average Flowrate:	60 gpm	Transducer Level:	94 ft
Effluent to Date:	0.080 Mgal		

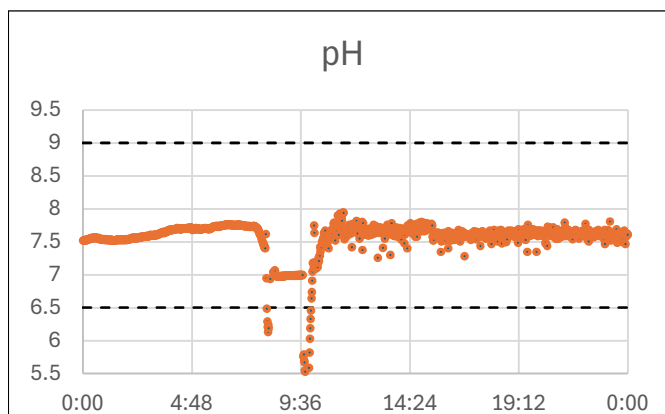

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	17°C	7.62	66 μ S/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	2 Gal	3 Gal	1 Gal
Vol. Remaining	230 Gal	96 Gal	50 Gal
Vol. Staged	255 Gal	550 Gal	270 Gal
Days Available	243 Days	215 Days	320 Days

Safety Issues/Concerns:

- N/A

Notes:

- Peter Hays onsite
- Installed and calibrated new pH probe in Finished Water Tank
- Started plant up at 08:45 am.
- Started discharging at 10:00 am.
- Time 15:30. Plant is running smooth. Numbers are looking great within parameters. No issues to report.