

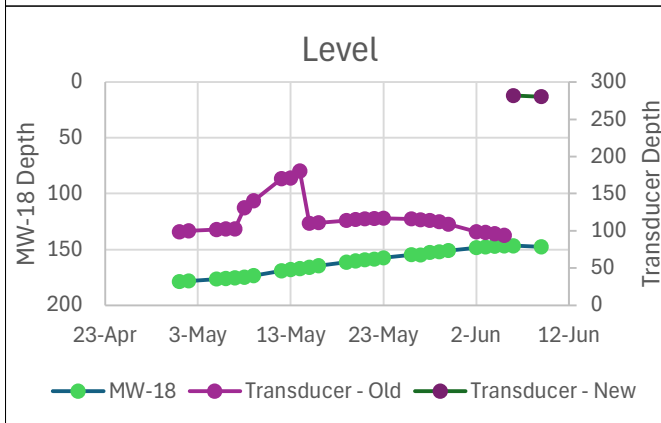


Schwartzwalder Daily Summary Report

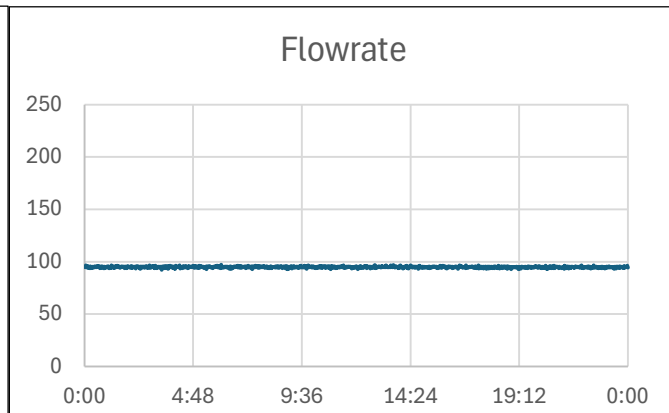

Report Date:	6/9/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	
Effluent Discharged:	0.130 Mgal	MW-18 Level:	148 ft
Average Flowrate:	95 gpm	Transducer Level:	281 ft
Effluent to Date:	0.610 Mgal		

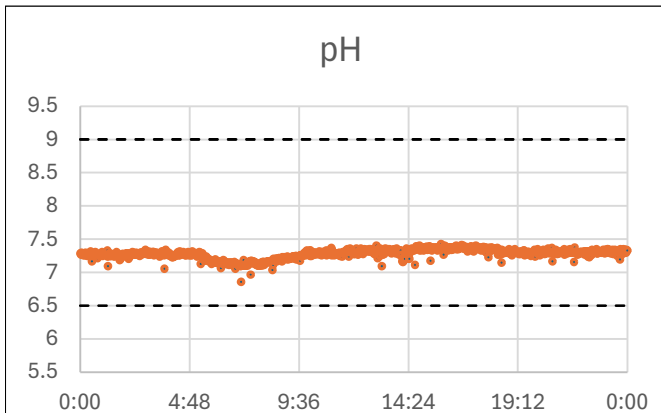

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	19°C	7.47	145 μ S/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	1 Gal	10 Gal	1 Gal
Vol. Remaining	222 Gal	58 Gal	44 Gal
Vol. Staged	255 Gal	550 Gal	270 Gal
Days Available	477 Days	58 Days	314 Days

Safety Issues/Concerns:

- N/A

Notes:

- TSS Outfall 001A Sample collected.
- Anti scalant pump discharge side fitting small leak fixed. Tighten the fitting.
- Peter and Jeff onsite for site tour.