

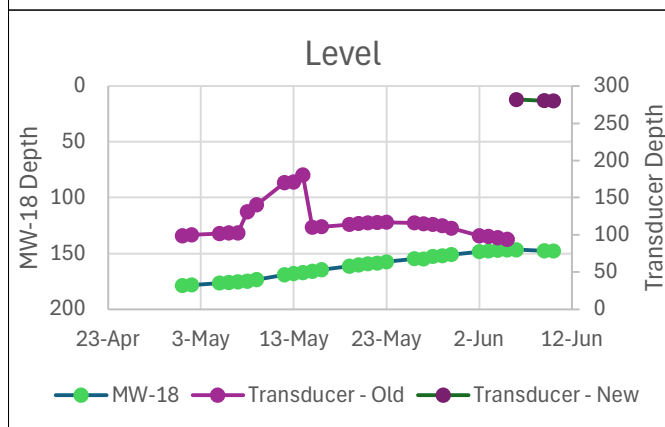


Schwartzwalder Daily Summary Report

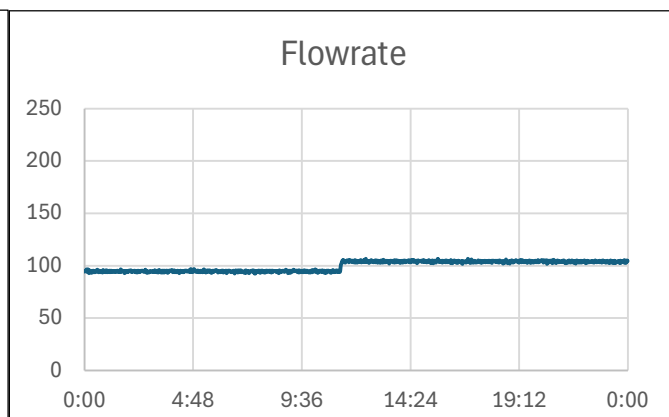

Report Date:	6/10/2025	Lead Operator:	Chris Prosper
		Assistant Operator(s):	Patrick Delaney Bryant A
Effluent Discharged:	0.130 Mgal	MW-18 Level:	148 ft
Average Flowrate:	95 gpm	Transducer Level:	280 ft
Effluent to Date:	0.740 Mgal		

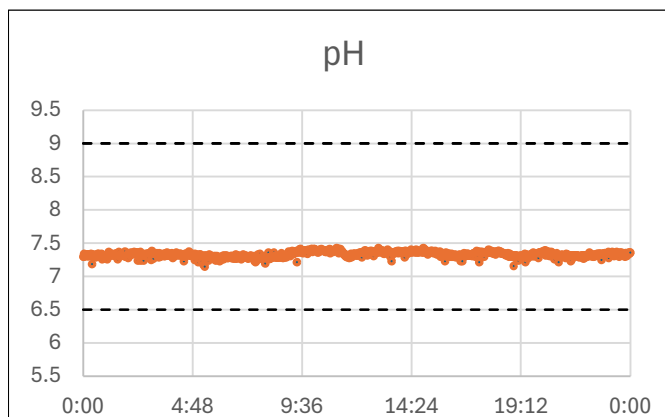

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	19°C	7.24	154 μ S/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	2 Gal	12 Gal	1 Gal
Vol. Remaining	220 Gal	61 Gal	43 Gal
Vol. Staged	255 Gal	534 Gal	270 Gal
Days Available	238 Days	49 Days	313 Days

Safety Issues/Concerns:

- N/A

Notes:

- Outfall 001A Bi-Weekly Sample Collected and Shipped.
- Set up pump to transfer NaOH.
- Transferred 16 gallons of NaOH.
- Raised Plant feed pump Hz from 43.6 Hz to 46.0 Hz.