

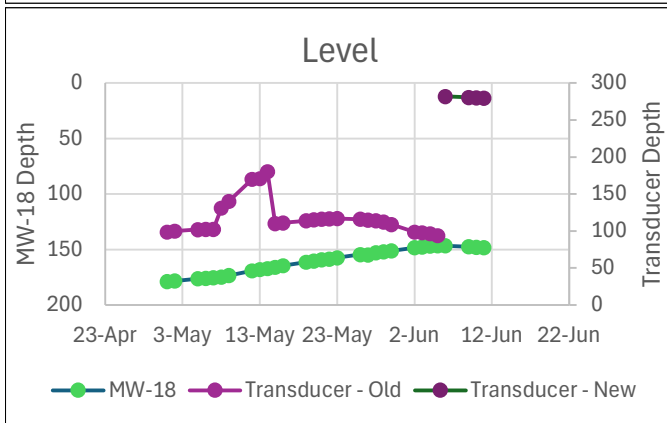


Schwartzwalder Daily Summary Report

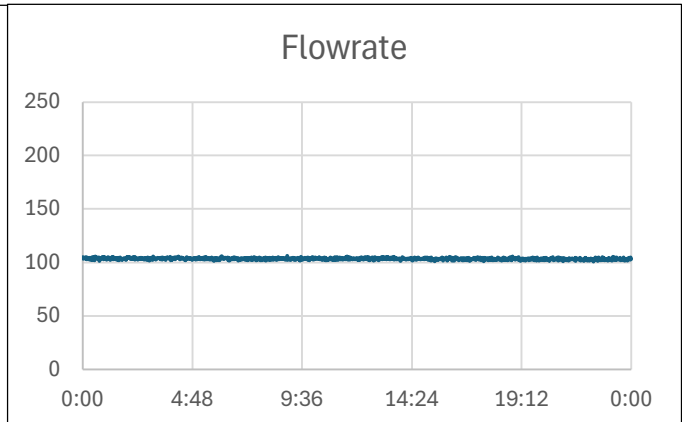

Report Date:	6/11/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.140 Mgal	MW-18 Level:	148 ft
Average Flowrate:	103 gpm	Transducer Level:	280 ft
Effluent to Date:	0.880 Mgal		

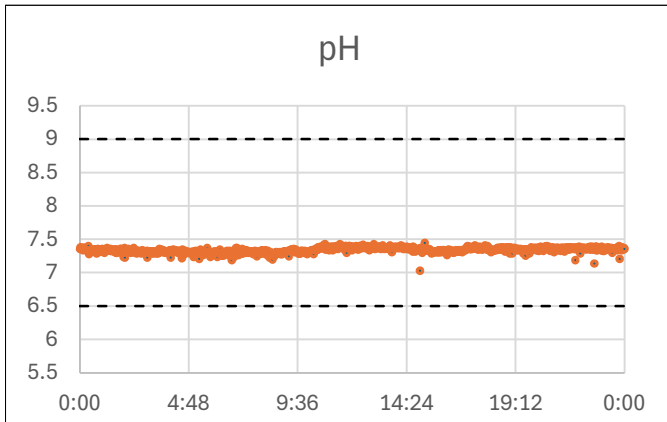

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	19°C	7.54	157 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	2 Gal	9 Gal	1 Gal
Vol. Remaining	473 Gal	52 Gal	42 Gal
Vol. Staged	0 Gal	516 Gal	270 Gal
Days Available	237 Days	67 Days	312 Days

Safety Issues/Concerns:

- N/A

Notes:

- Collected and shipped Outfall 001A COD TSS and Quarterly TDS samples.
- Transferred 13 gallons of NaOH.