

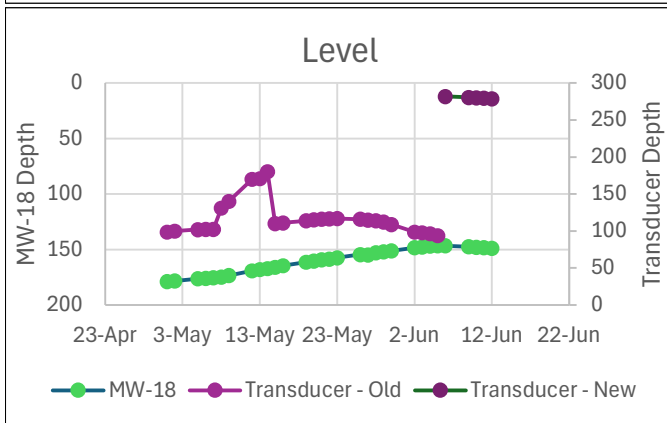


Schwartzwalder Daily Summary Report

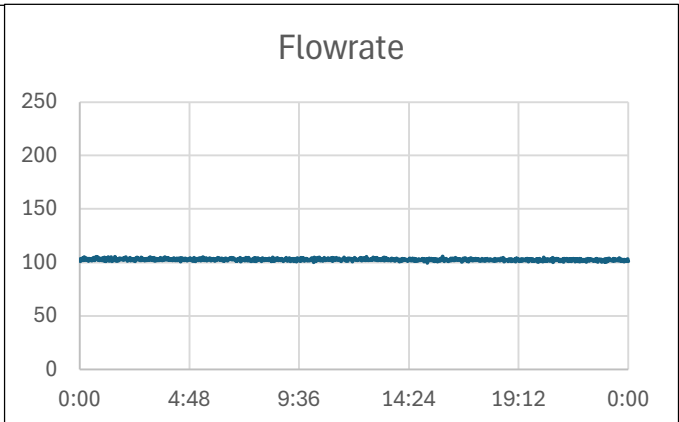

Report Date:	6/12/2025	Lead Operator:	Patrick D
		Assistant Operator(s):	Bryant A

Effluent Discharged:	0.140 Mgal	MW-18 Level:	149 ft
Average Flowrate:	103 gpm	Transducer Level:	279 ft
Effluent to Date:	1.020 Mgal		

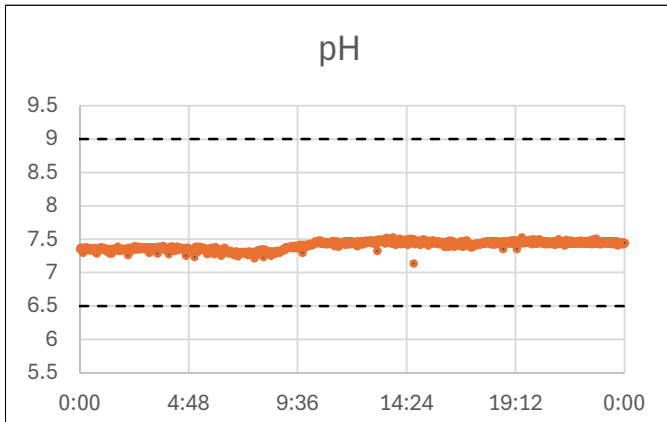

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	7.58	158 μ S/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	2 Gal	11 Gal	1 Gal
Vol. Remaining	471 Gal	72 Gal	41 Gal
Vol. Staged	0 Gal	333 Gal	270 Gal
Days Available	236 Days	37 Days	311 Days

Safety Issues/Concerns:
- N/A

Notes:

- Transferred 183 gallons of NaOH with new transfer pump.
- Primed RO#2 Anit-scalant pump.
- Staged tools for Item-B29 work.
- Replaced Mine Pump VFD fan filters.