

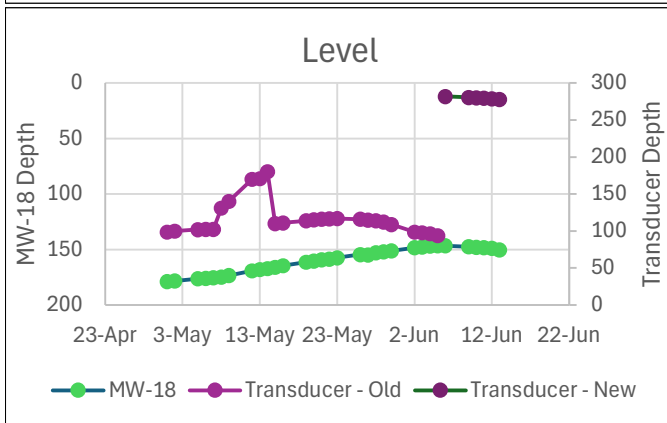


Schwartzwalder Daily Summary Report

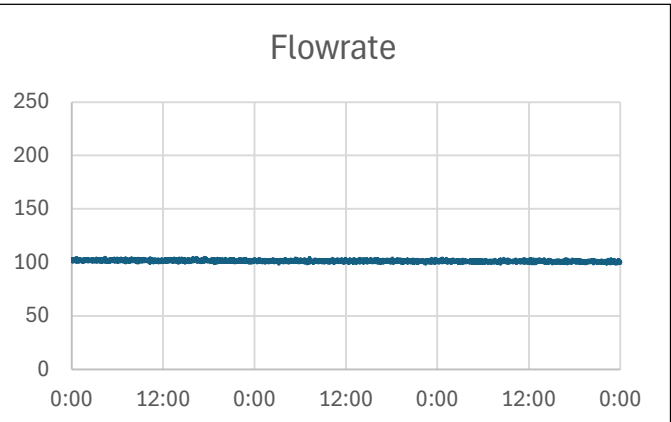

Report Date:	6/13/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.420 Mgal	MW-18 Level:	150 ft
Average Flowrate:	101 gpm	Transducer Level:	278 ft
Effluent to Date:	1.440 Mgal		

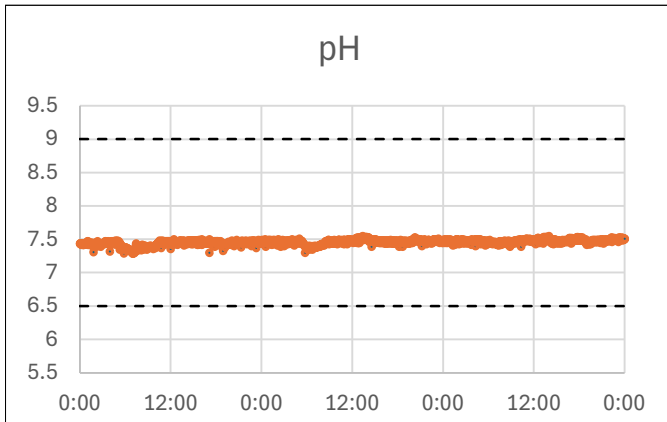

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	7.57	157 μ S/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	14 Gal	35 Gal	5 Gal
Vol. Remaining	469 Gal	209 Gal	40 Gal
Vol. Staged	0 Gal	333 Gal	270 Gal
Days Available	34 Days	16 Days	62 Days

Safety Issues/Concerns:
 - N/A

Notes:
 - Collected Weekly Outfall TSS 001A Sample.
 -