

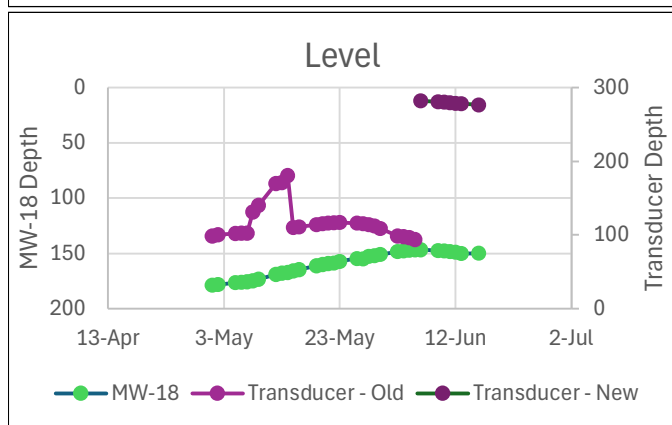


Schwartzwalder Daily Summary Report

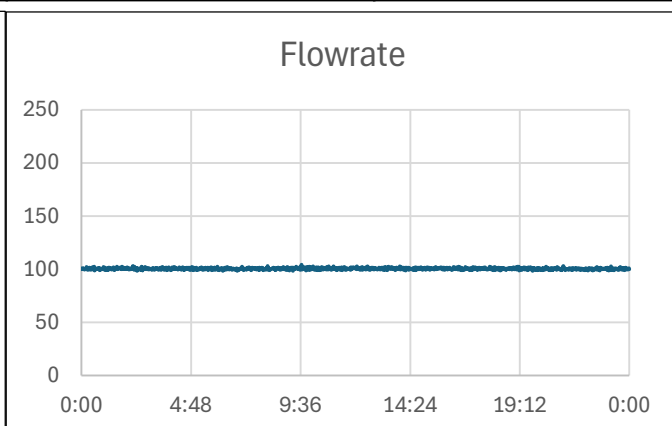

Report Date:	6/16/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.140 Mgal	MW-18 Level:	149.9 ft
Average Flowrate:	100.6 gpm	Transducer Level:	276.5 ft
Effluent to Date:	1.580 Mgal		

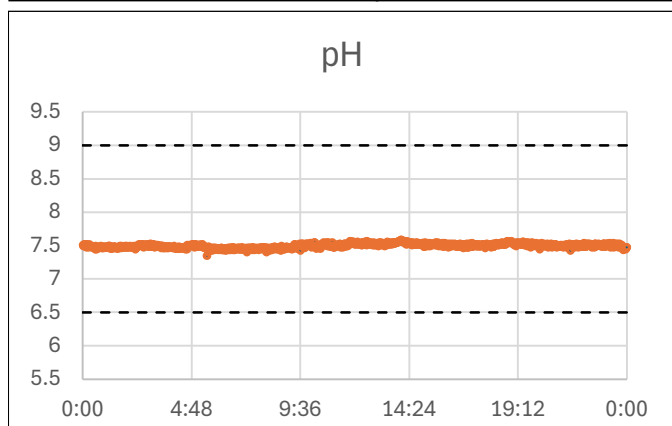

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	7.61	159 μ S/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	14 Gal	12 Gal	3 Gal
Vol. Remaining	455 Gal	209 Gal	40 Gal
Vol. Staged	0 Gal	333 Gal	270 Gal
Days Available	33 Days	47 Days	103 Days

Safety Issues/Concerns:

- N/A

Notes:

- Collected Weekly Outfall 001A TSS Sample

-