

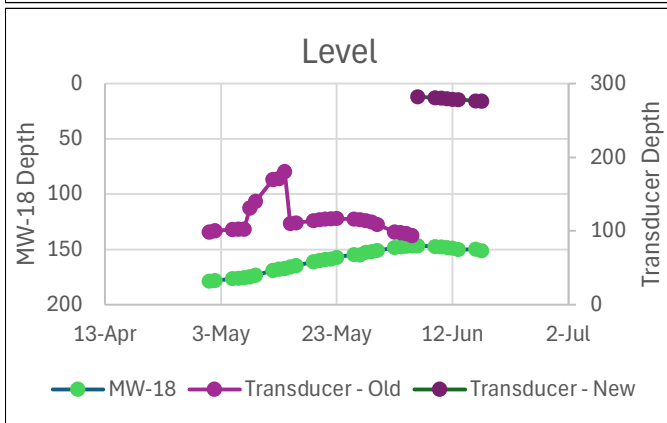


Schwartzwalder Daily Summary Report

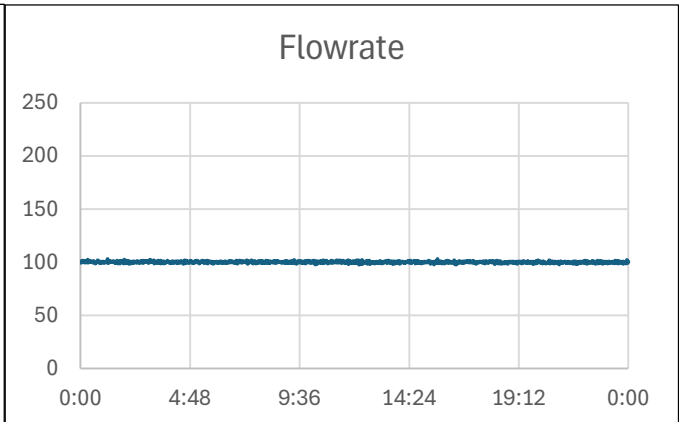

Report Date:	6/17/2025	Lead Operator:	Chris Prosper
		Assistant Operator(s):	Bryant A

Effluent Discharged:	0.140 Mgal	MW-18 Level:	151.4 ft
Average Flowrate:	100.2 gpm	Transducer Level:	276.0 ft
Effluent to Date:	1.720 Mgal		

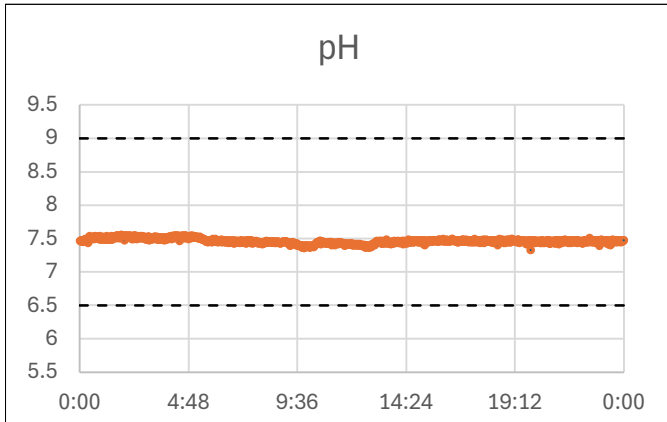

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	19°C	7.61	159 μ S/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	7 Gal	11 Gal	8 Gal
Vol. Remaining	452 Gal	198 Gal	38 Gal
Vol. Staged	0 Gal	333 Gal	270 Gal
Days Available	65 Days	48 Days	39 Days

Safety Issues/Concerns:

- N/A

Notes:

- Collected and Shipped SW-AWD , SW-BPL and Denver Water samples.

-