

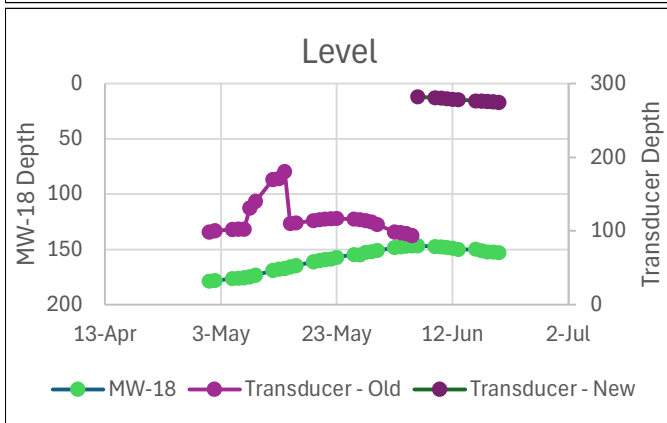


Schwartzwalder Daily Summary Report

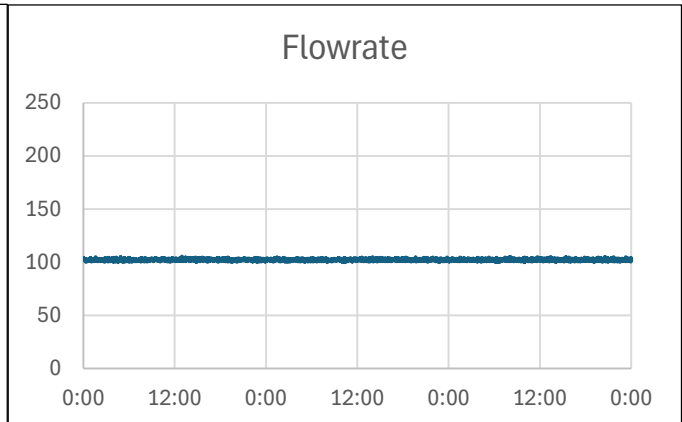

Report Date:	6/20/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.420 Mgal	MW-18 Level:	152.9 ft
Average Flowrate:	102.4 gpm	Transducer Level:	274.2 ft
Effluent to Date:	2.420 Mgal		

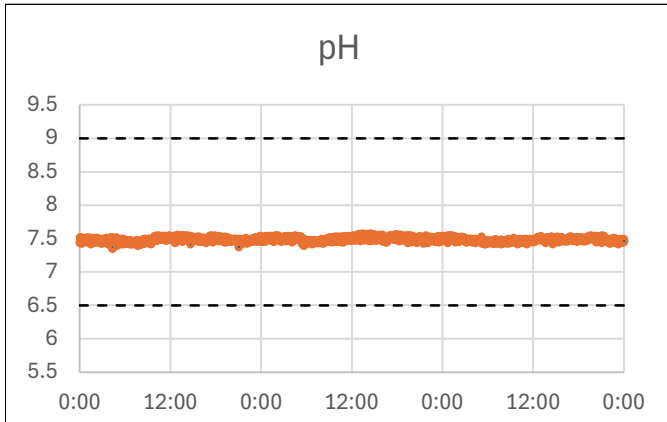

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	7.74	160 μ S/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	11 Gal	35 Gal	10 Gal
Vol. Remaining	436 Gal	164 Gal	50 Gal
Vol. Staged	0 Gal	333 Gal	240 Gal
Days Available	40 Days	14 Days	29 Days

Safety Issues/Concerns:
- N/A

Notes:
- Collected Outfall 001A Weekly TSS Sample.