

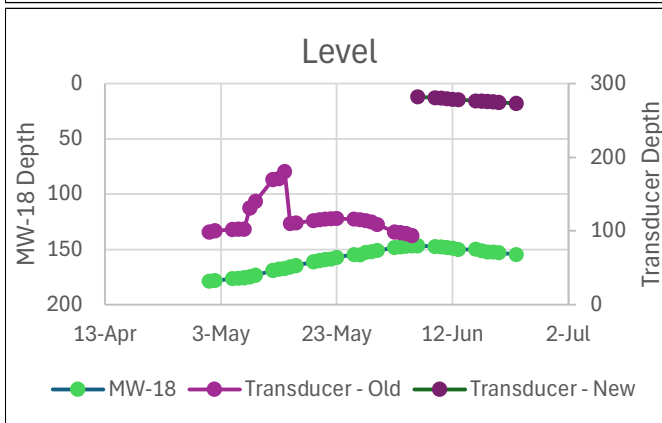


Schwartzwalder Daily Summary Report

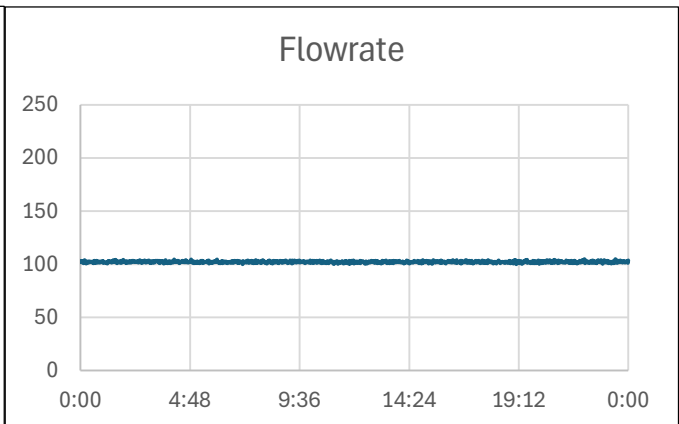

Report Date:	6/23/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.140 Mgal	MW-18 Level:	154.8 ft
Average Flowrate:	102.3 gpm	Transducer Level:	272.9 ft
Effluent to Date:	2.560 Mgal		

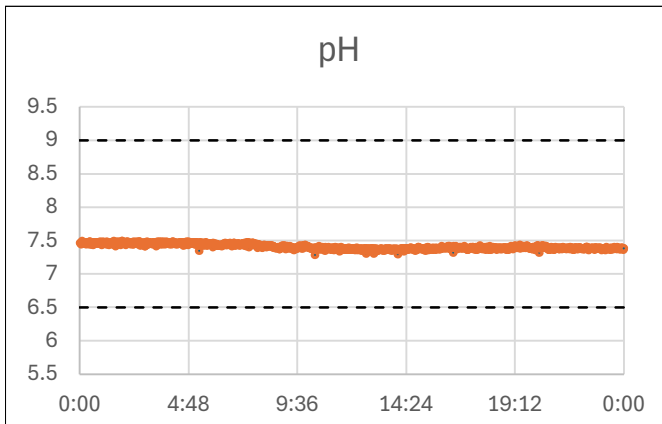

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	19°C	7.18	155 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	3 Gal	12 Gal	3 Gal
Vol. Remaining	425 Gal	129 Gal	40 Gal
Vol. Staged	0 Gal	333 Gal	240 Gal
Days Available	142 Days	40 Days	93 Days

Safety Issues/Concerns:
- N/A

Notes:
- Collected Outfall 001A Weekly TSS Sample.
- Collected and delivered Outfall 001A Quarterly WET sample to Seacrest.