

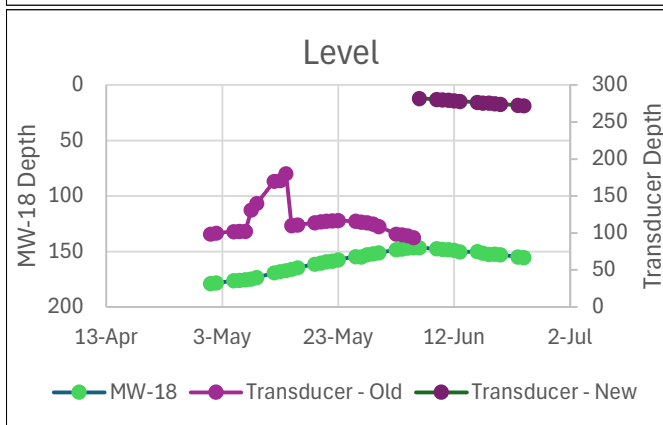


Schwartzwalder Daily Summary Report

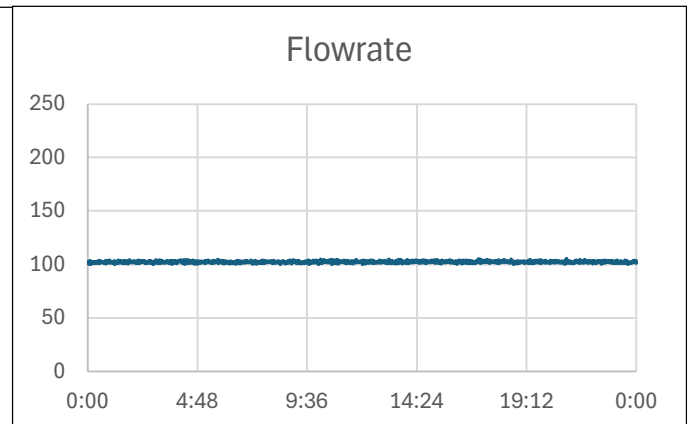

Report Date:	6/24/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.140 Mgal	MW-18 Level:	155.4 ft
Average Flowrate:	102.4 gpm	Transducer Level:	272.1 ft
Effluent to Date:	2.700 Mgal		

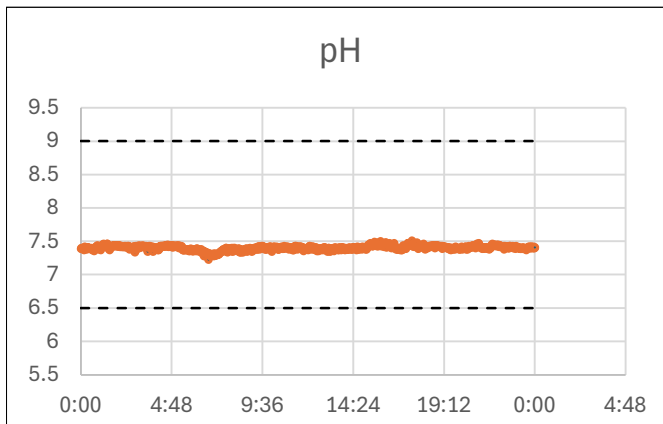

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	19°C	7.1	154 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	3 Gal	11 Gal	4 Gal
Vol. Remaining	422 Gal	117 Gal	37 Gal
Vol. Staged	0 Gal	333 Gal	240 Gal
Days Available	141 Days	42 Days	69 Days

Safety Issues/Concerns:
- N/A

Notes:
- Collected and delivered Outfall 001A Quarterly WET sample to Seacrest.