

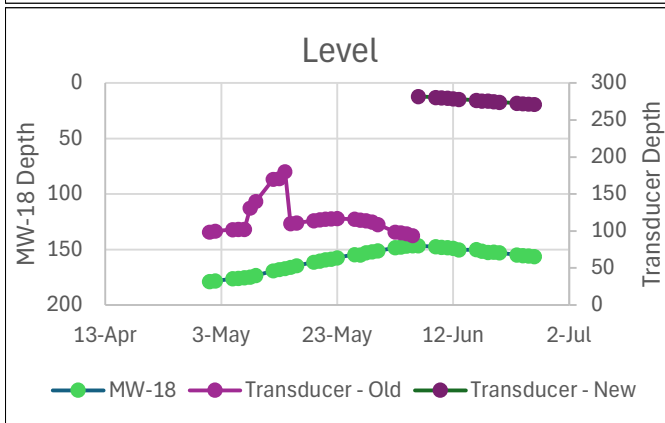


Schwartzwalder Daily Summary Report

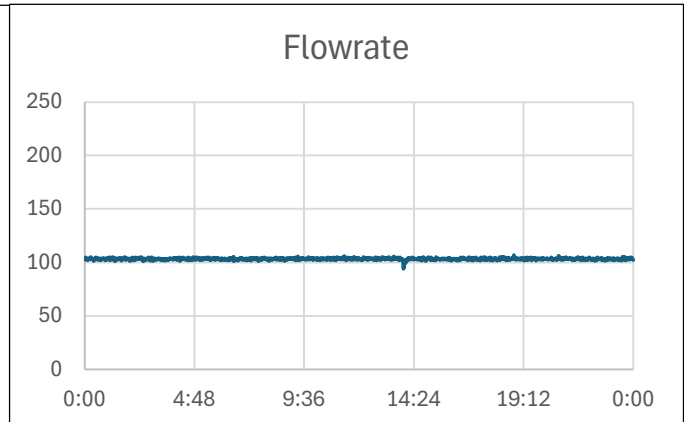

Report Date:	6/26/2025	Lead Operator:	Adam B
		Assistant Operator(s):	Patrick D Bryant A
Effluent Discharged:	0.140 Mgal	MW-18 Level:	156.2 ft
Average Flowrate:	103.3 gpm	Transducer Level:	271.0 ft
Effluent to Date:	2.980 Mgal		

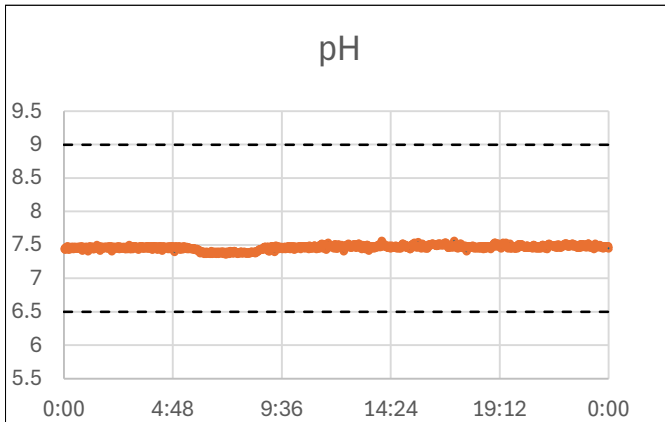

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	7.98	153 μ S/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	2 Gal	11 Gal	4 Gal
Vol. Remaining	416 Gal	242 Gal	30 Gal
Vol. Staged	0 Gal	333 Gal	240 Gal
Days Available	208 Days	52 Days	68 Days

Safety Issues/Concerns:

- N/A

Notes:

- Peter Hays and CDPHE onsite inspection.
- Batched 30 gallons of BaCl.