

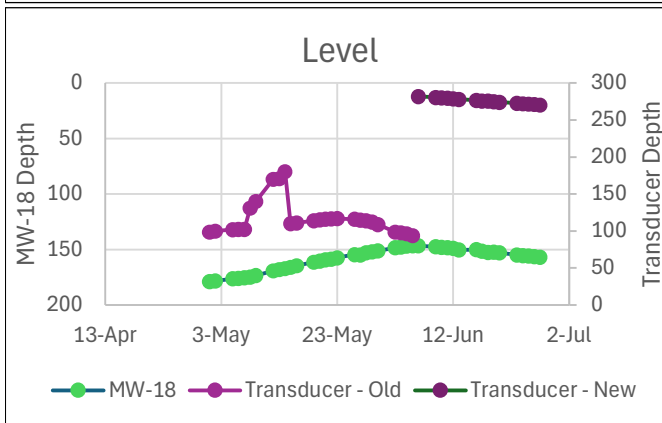


Schwartzwalder Daily Summary Report

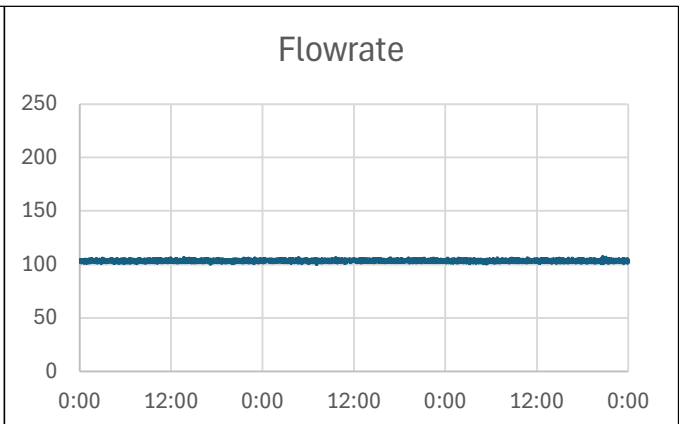

Report Date:	6/27/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.140 Mgal	MW-18 Level:	156.8 ft
Average Flowrate:	103.4 gpm	Transducer Level:	270.4 ft
Effluent to Date:	3.120 Mgal		

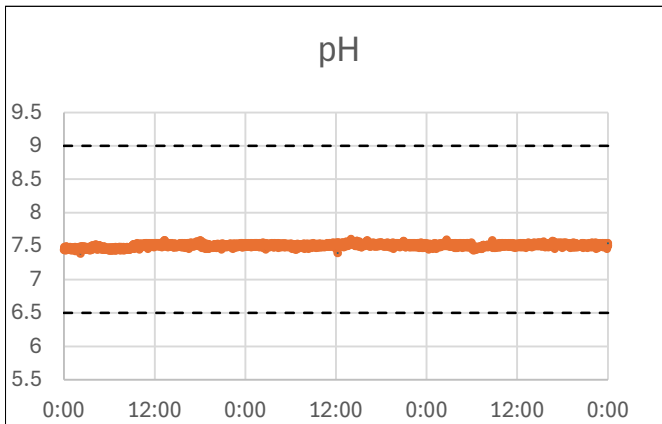

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	7.74	156 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	6 Gal	10 Gal	11 Gal
Vol. Remaining	414 Gal	234 Gal	50 Gal
Vol. Staged	0 Gal	333 Gal	210 Gal
Days Available	69 Days	57 Days	24 Days

Safety Issues/Concerns:

- N/A

Notes:

- Collected Outfall 001A TSS Sample.
- Organized all Lab Coolers in the WTP.