

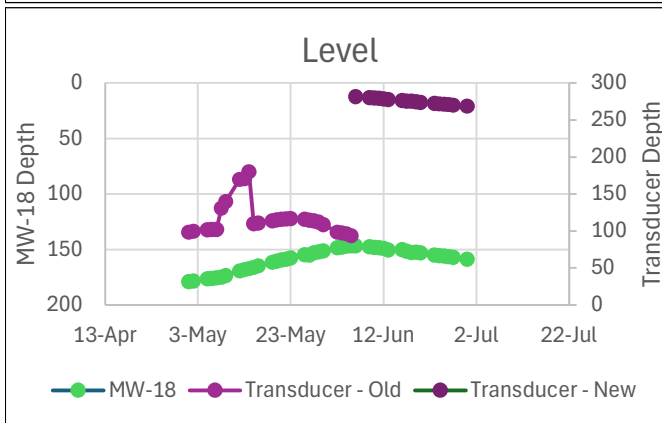


Schwartzwalder Daily Summary Report

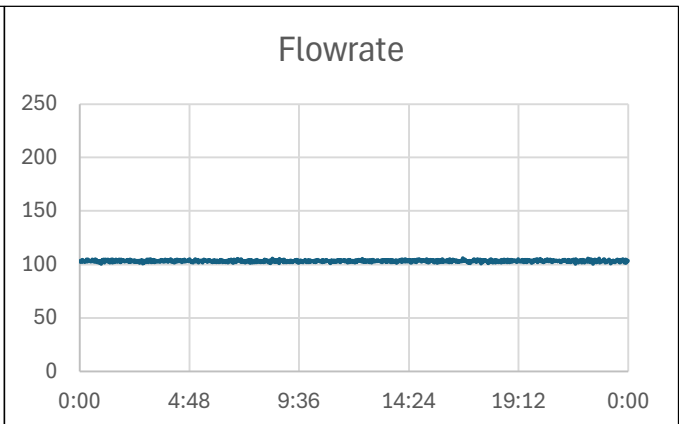

Report Date:	6/30/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.140 Mgal	MW-18 Level:	158.7 ft
Average Flowrate:	103.3 gpm	Transducer Level:	268.8 ft
Effluent to Date:	3.260 Mgal		

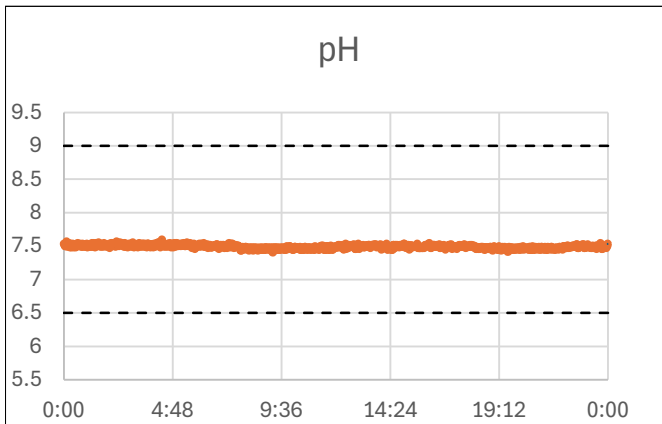

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	19°C	7.35	149 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	3 Gal	6 Gal	2 Gal
Vol. Remaining	408 Gal	244 Gal	39 Gal
Vol. Staged	0 Gal	140 Gal	200 Gal
Days Available	136 Days	65 Days	120 Days

Safety Issues/Concerns:
- N/A

Notes:
- Collected Outfall 001A TSS Sample.