

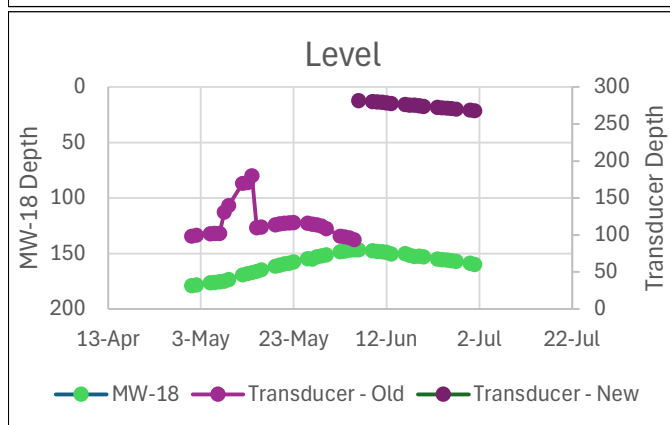


Schwartzwalder Daily Summary Report

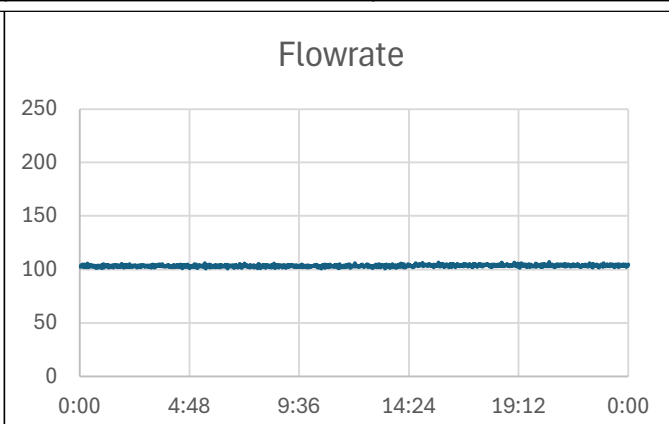

Report Date:	7/1/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	
Effluent Discharged:	0.142 Mgal	MW-18 Level:	159.6 ft
Average Flowrate:	103.4 gpm	Transducer Level:	267.9 ft
Effluent to Date:	3.721 Mgal		

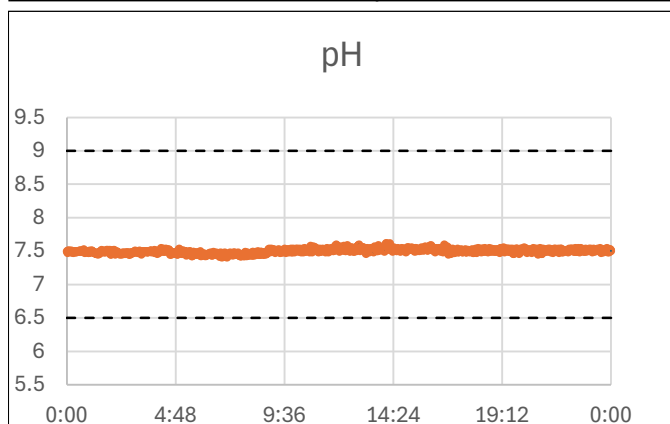

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	8.18	149 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	3 Gal	6 Gal	2 Gal
Vol. Remaining	405 Gal	238 Gal	37 Gal
Vol. Staged	0 Gal	140 Gal	200 Gal
Days Available	135 Days	64 Days	119 Days

Safety Issues/Concerns:

- N/A

Notes:

- Collected Outfall 001A TSS and COD Weekly Samples.
- Raised Plant Feed Pump from 44.6Hz to 44.8Hz.
- Prepped Plant for shutdown and inspection of RO#2, Vessel#6 and cartridge filter changeout

Note: There is an increase in the total value listed in the "Effluent to date" box of this report. This is because all of the values presented in previous reports were not reported to sufficient decimal places leading to a difference of 0.31 Mgal that was being under reported. The value shown above is the correct total representing the total volume of effluent discharged to date.