

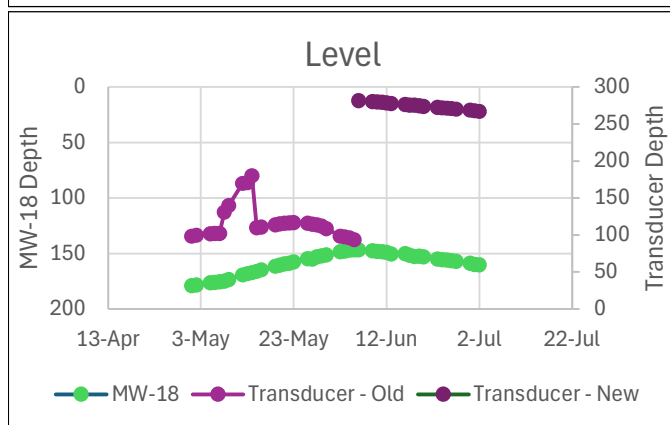


# Schwartzwalder Daily Summary Report

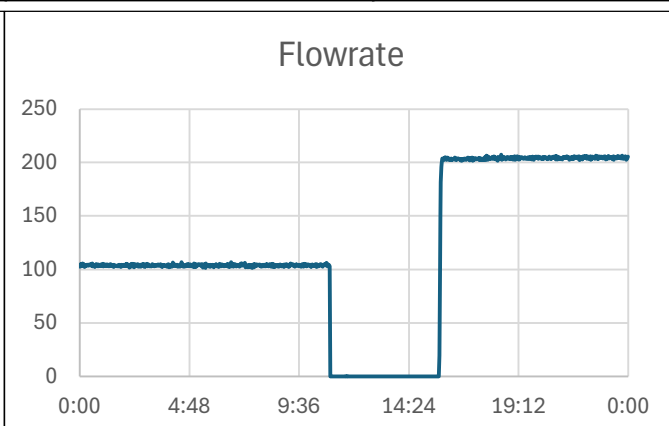

Report Date:	7/2/2025	Lead Operator:	Adam B
		Assistant Operator(s):	Patrick D. Bryant A
Effluent Discharged:	0.312 Mgal	MW-18 Level:	160.1 ft
Average Flowrate:	147.8 gpm	Transducer Level:	267.2 ft
Effluent to Date:	4.033 Mgal		

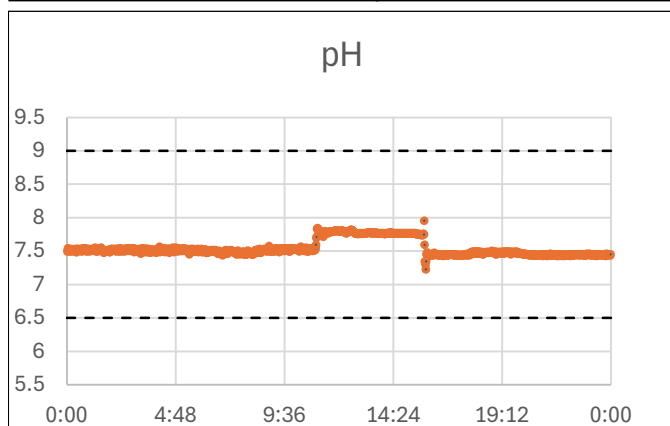

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	21°C	7.2	149 $\mu$ S/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	1 Gal	15 Gal	2 Gal
Vol. Remaining	402 Gal	232 Gal	35 Gal
Vol. Staged	0 Gal	140 Gal	200 Gal
Days Available	402 Days	24 Days	118 Days

## Safety Issues/Concerns:

- N/A

## Notes:

- Peter Hays onsite for Operations meeting.
- Plant Shut-down at 11:05.
- RO#2, Vessel #6. Inspected. Shim rings have been replaced with better fitting ones.
- Plant Start-up at 15:45. Both RO's running.