

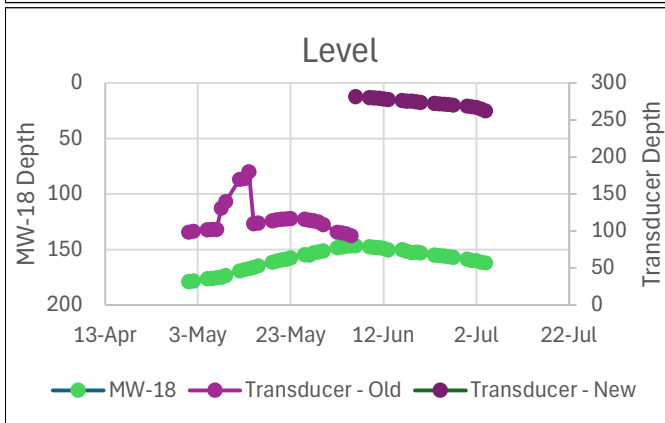


Schwartzwalder Daily Summary Report

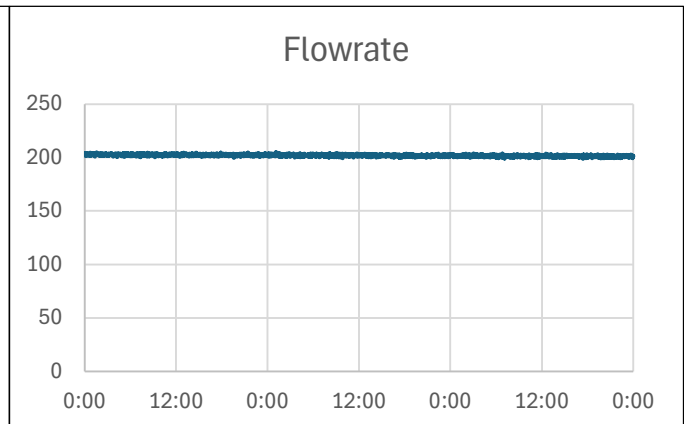

Report Date:	7/4/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.842 Mgal	MW-18 Level:	162.1 ft
Average Flowrate:	201.9 gpm	Transducer Level:	262.6 ft
Effluent to Date:	5.156 Mgal		

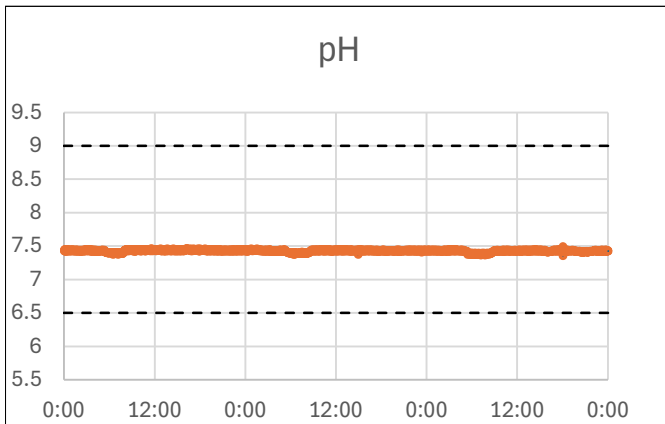

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	21°C	7.63	186 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	27 Gal	85 Gal	12 Gal
Vol. Remaining	377 Gal	150 Gal	50 Gal
Vol. Staged	0 Gal	140 Gal	150 Gal
Days Available	14 Days	3 Days	17 Days

Safety Issues/Concerns:

- N/A

Notes:

- Collected Outfall 001A TSS Weekly Sample.