

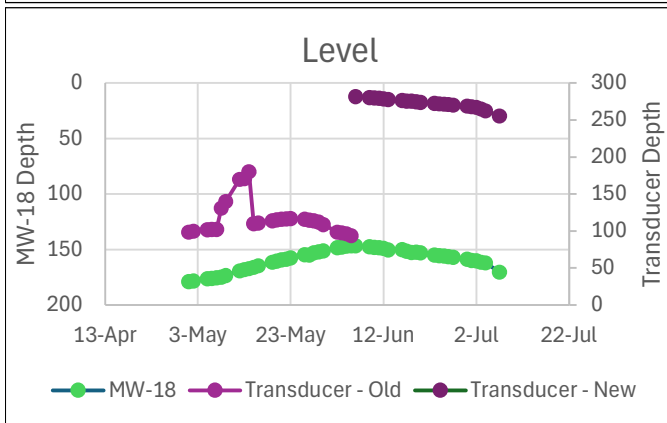


Schwartzwalder Daily Summary Report

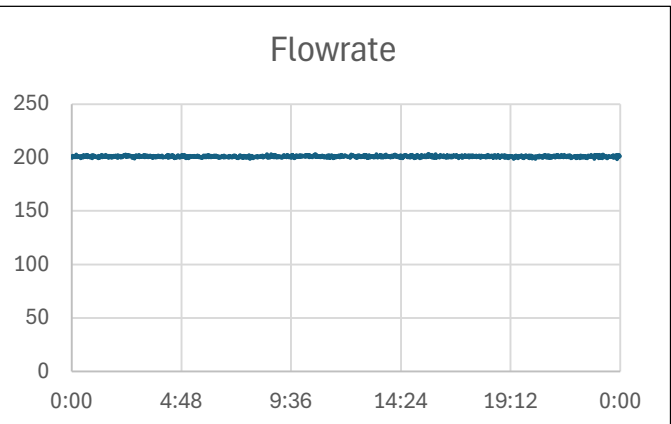

Report Date:	7/7/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.279 Mgal	MW-18 Level:	170.3 ft
Average Flowrate:	200.9 gpm	Transducer Level:	255.7 ft
Effluent to Date:	5.435 Mgal		

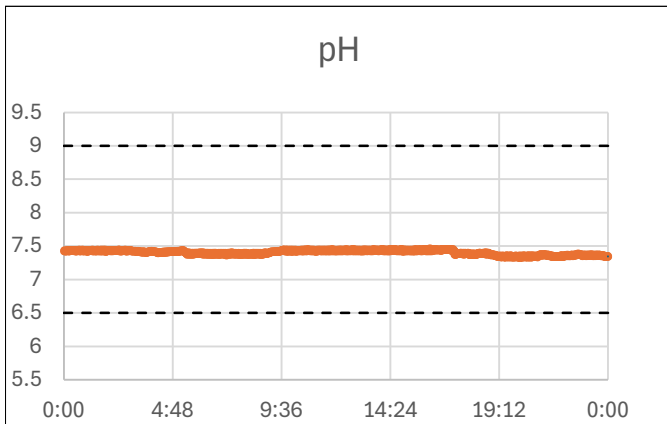

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	21°C	7.44	186 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	5 Gal	15 Gal	6 Gal
Vol. Remaining	350 Gal	65 Gal	38 Gal
Vol. Staged	0 Gal	140 Gal	150 Gal
Days Available	70 Days	14 Days	31 Days

Safety Issues/Concerns:
- N/A

Notes:
- Collected Outfall 001A TSS Weekly Sample.