

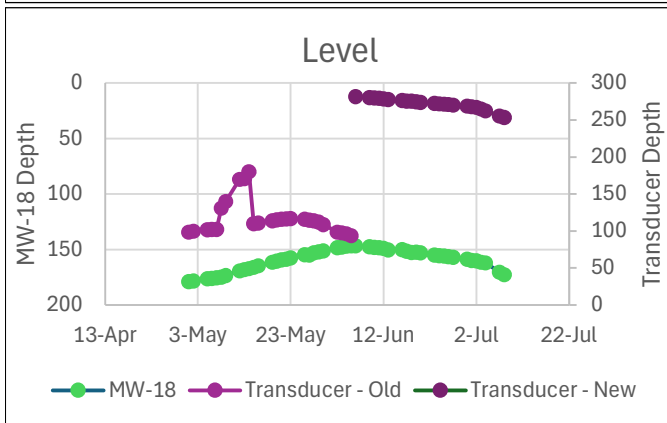


# Schwartzwalder Daily Summary Report

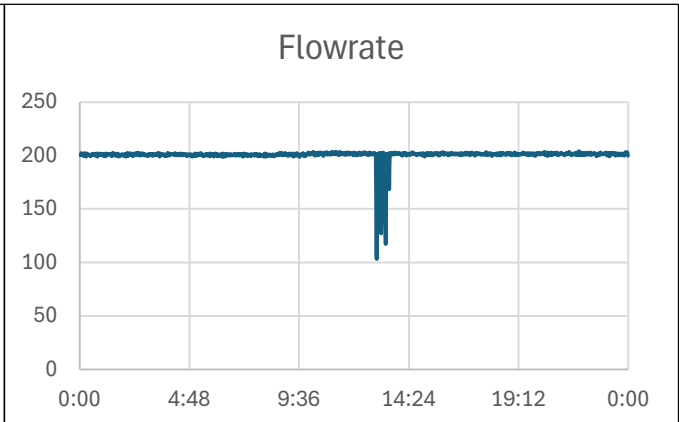

Report Date:	7/8/2025	Lead Operator:	Patrick D
		Assistant Operator(s):	Bryant A

Effluent Discharged:	0.280 Mgal	MW-18 Level:	172.6 ft
Average Flowrate:	200.7 gpm	Transducer Level:	253.6 ft
Effluent to Date:	5.715 Mgal		

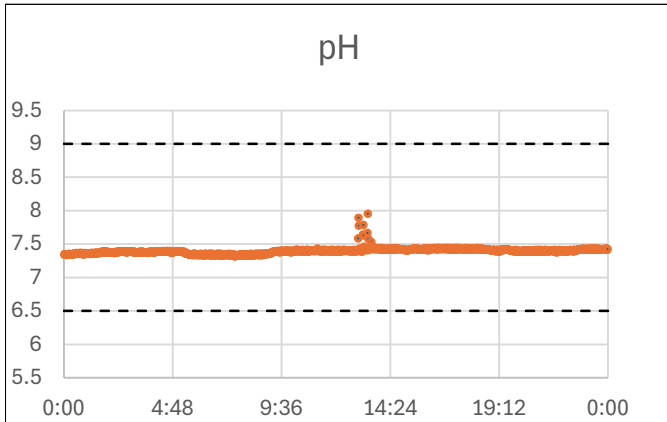

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	21°C	7.51	184 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	4 Gal	13 Gal	0 Gal
Vol. Remaining	345 Gal	40 Gal	32 Gal
Vol. Staged	0 Gal	425 Gal	150 Gal
Days Available	86 Days	36 Days	#DIV/0!

## Safety Issues/Concerns:

- N/A

## Notes:

- Transferred 220 gallons of 50% NaOH.
- Received Chemical Delivery of 50% NaOH 520 gallons.
- Washed out old NaOH Tote , this caused the Plant Flow to drop and pH too rise but still within set Parameters.
- Removed 1 NaOH Tote offsite via Chemical Delivery Driver.