

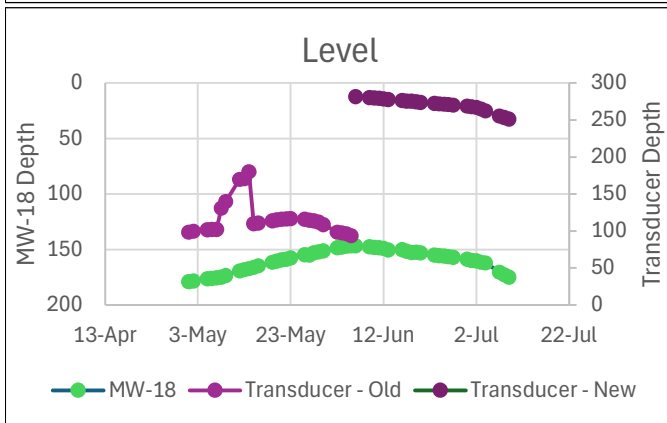


Schwartzwalder Daily Summary Report

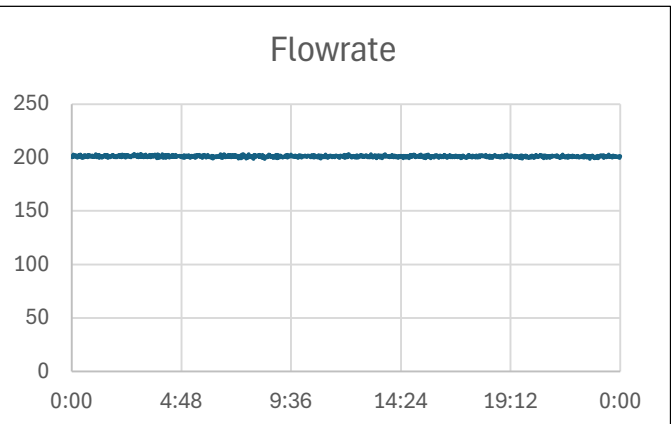

Report Date:	7/9/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.355 Mgal	MW-18 Level:	174.9 ft
Average Flowrate:	178.7 gpm	Transducer Level:	251.5 ft
Effluent to Date:	6.070 Mgal		

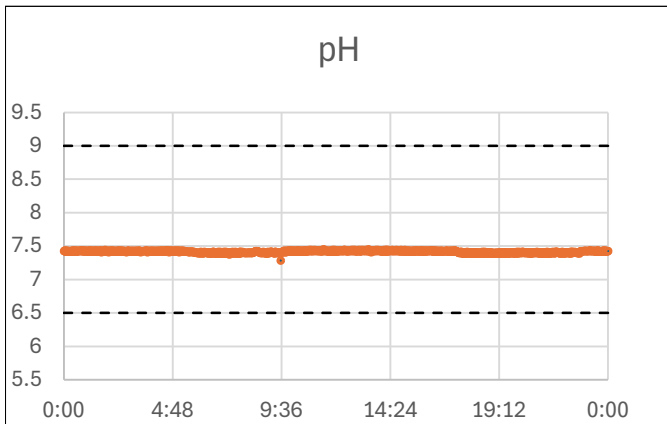

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	21°C	7.35	183 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	4 Gal	23 Gal	5 Gal
Vol. Remaining	341 Gal	239 Gal	30 Gal
Vol. Staged	0 Gal	425 Gal	150 Gal
Days Available	85 Days	29 Days	36 Days

Safety Issues/Concerns:
- N/A

Notes:
- Collected and Shipped Outfall 001A Weekly TSS & COD Samples.