

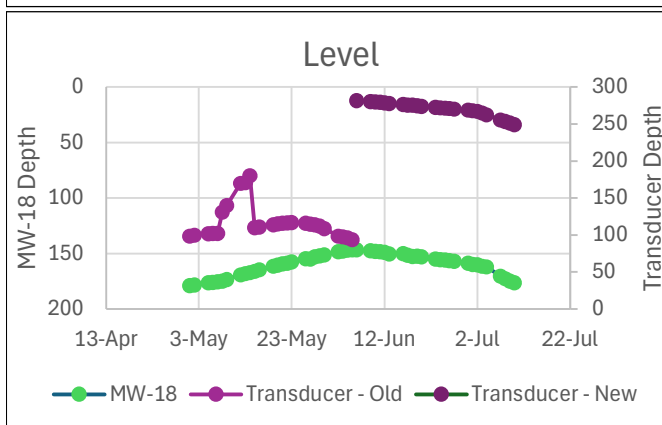


# Schwartzwalder Daily Summary Report

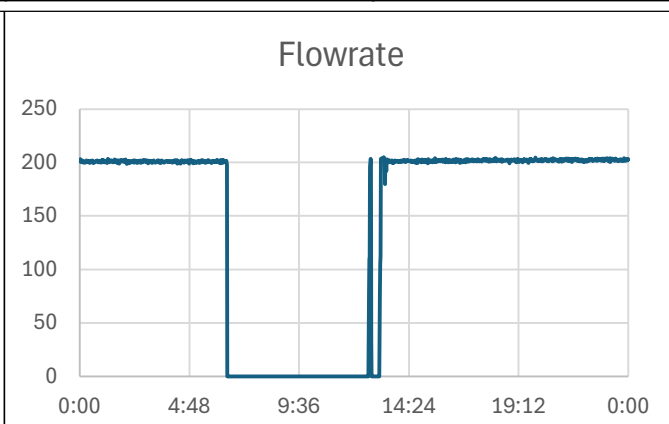

|                      |            |                        |                       |
|----------------------|------------|------------------------|-----------------------|
| Report Date:         | 7/10/2025  | Lead Operator:         | Chris P               |
|                      |            | Assistant Operator(s): | Patrick D<br>Bryant A |
| Effluent Discharged: | 0.203 Mgal | MW-18 Level:           | 176.2 ft              |
| Average Flowrate:    | 146.2 gpm  | Transducer Level:      | 249.4 ft              |
| Effluent to Date:    | 6.273 Mgal |                        |                       |

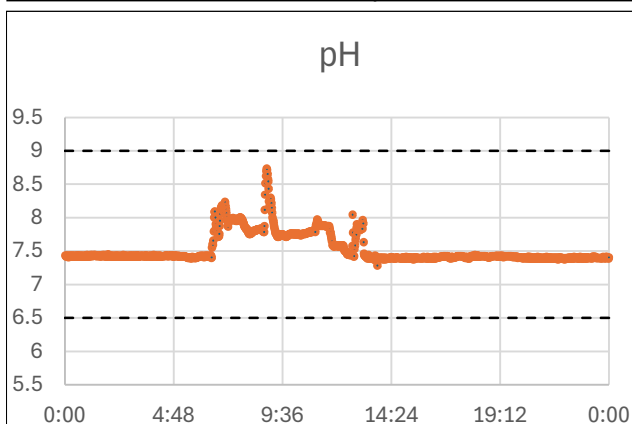

| Finished Water Quality |             |         |                |
|------------------------|-------------|---------|----------------|
| Parameters             | Temp        | pH      | Cond           |
| Values                 | 20°C        | 7.43    | 183 $\mu$ S/cm |
| Chemical Inventory     |             |         |                |
| Chemicals              | Antiscalant | NaOH    | BaCl           |
| Vol. Used              | 4 Gal       | 17 Gal  | 2 Gal          |
| Vol. Remaining         | 337 Gal     | 216 Gal | 25 Gal         |
| Vol. Staged            | 0 Gal       | 425 Gal | 100 Gal        |
| Days Available         | 84 Days     | 37 Days | 63 Days        |

## Safety Issues/Concerns:

- N/A

## Notes:

- Plant SHUT DOWN at 06:00.
- RSO Patrick Hendrickson onsite for cartridge filter samples.
- Removed one Cartridge filter from each Canister for sampling and replaced them with new filters.
- Inspected RO#2 Vessel's 4 & 5. Vessel 5 end cap gasket replaced. Shimmed both Vessel's 4 & 5.
- Plant START UP at 13:45.
- Batched 25gal of BaCl.