

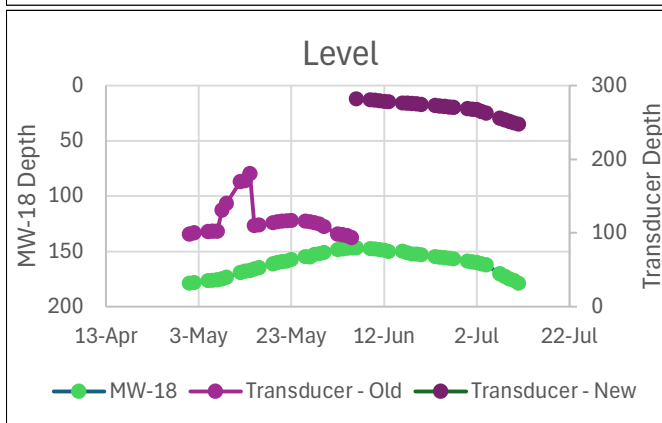


Schwartzwalder Daily Summary Report

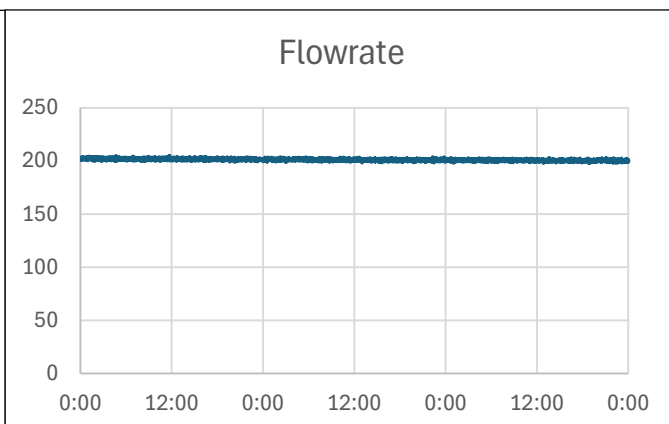

Report Date:	7/11/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	
Effluent Discharged:	0.838 Mgal	MW-18 Level:	178.9 ft
Average Flowrate:	201.2 gpm	Transducer Level:	247.8 ft
Effluent to Date:	7.111 Mgal		

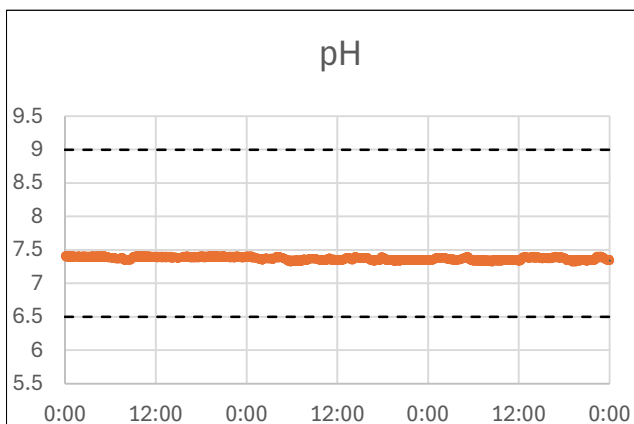

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	7.25	183 μ S/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	34 Gal	66 Gal	10 Gal
Vol. Remaining	333 Gal	199 Gal	50 Gal
Vol. Staged	0 Gal	425 Gal	100 Gal
Days Available	10 Days	9 Days	15 Days

Safety Issues/Concerns:

- N/A

Notes:

- Collected Outfall 001A Weekly TSS Sample.