

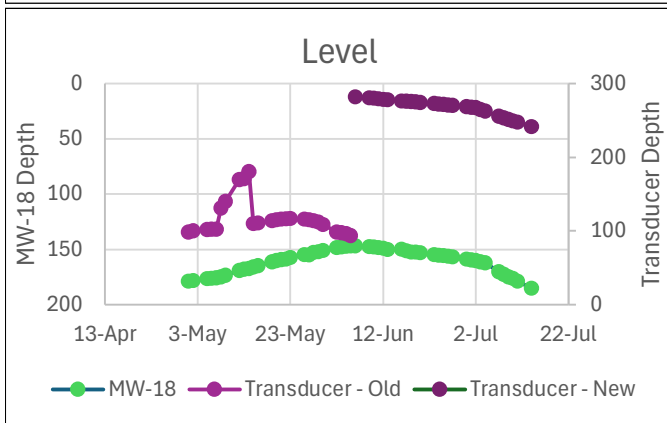


Schwartzwalder Daily Summary Report

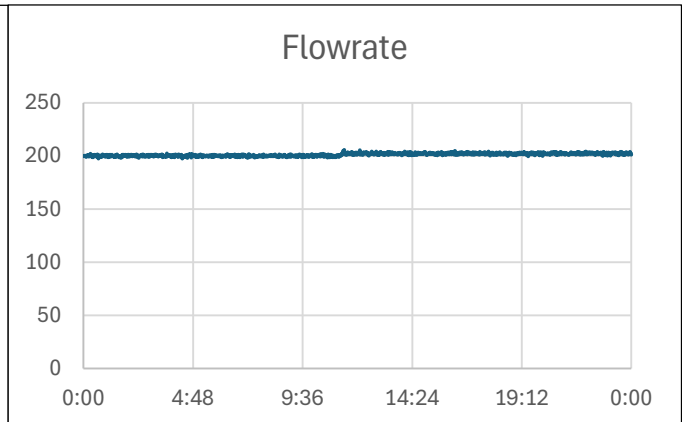

Report Date:	7/14/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.280 Mgal	MW-18 Level:	185.0 ft
Average Flowrate:	201.3 gpm	Transducer Level:	241.4 ft
Effluent to Date:	7.391 Mgal		

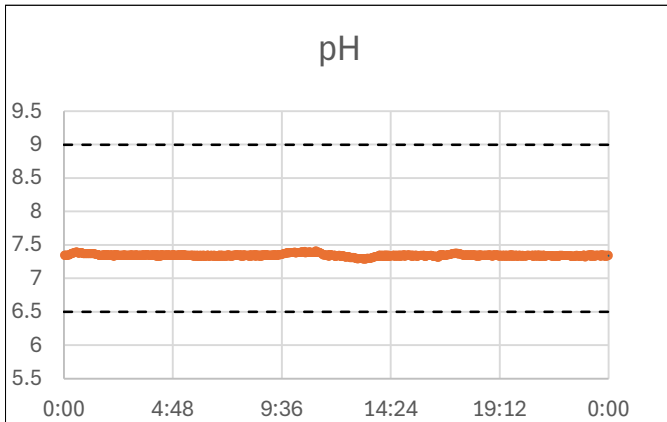

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	7.07	12 μ S/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	23 Gal	23 Gal	5 Gal
Vol. Remaining	299 Gal	133 Gal	40 Gal
Vol. Staged	0 Gal	425 Gal	150 Gal
Days Available	13 Days	24 Days	38 Days

Safety Issues/Concerns:

- N/A

Notes:

- Collected Outfall 001A Weekly TSS Sample.
- Raised Mine Pump Hertz from 56.7Hz to 57.3Hz.