

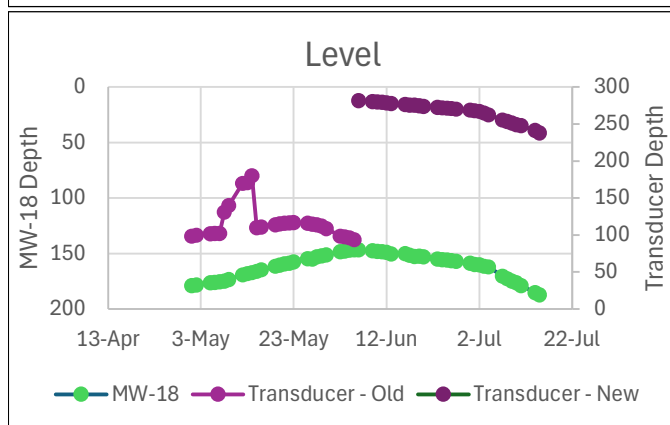


Schwartzwalder Daily Summary Report

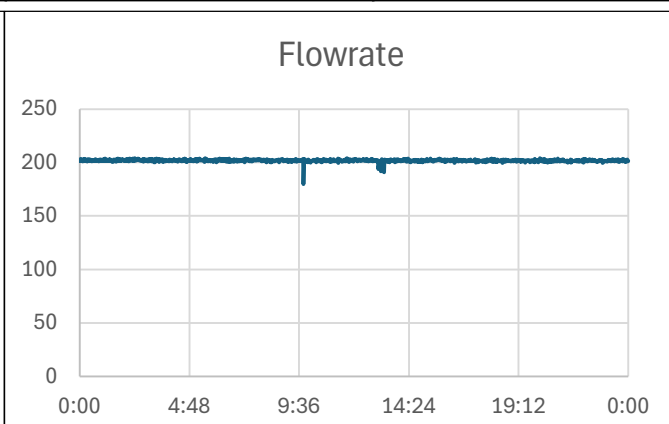

Report Date:	7/15/2025	Lead Operator:	Patrick D
		Assistant Operator(s):	Bryant A
Effluent Discharged:	0.279 Mgal	MW-18 Level:	187.2 ft
Average Flowrate:	201.8 gpm	Transducer Level:	238.3 ft
Effluent to Date:	7.670 Mgal		

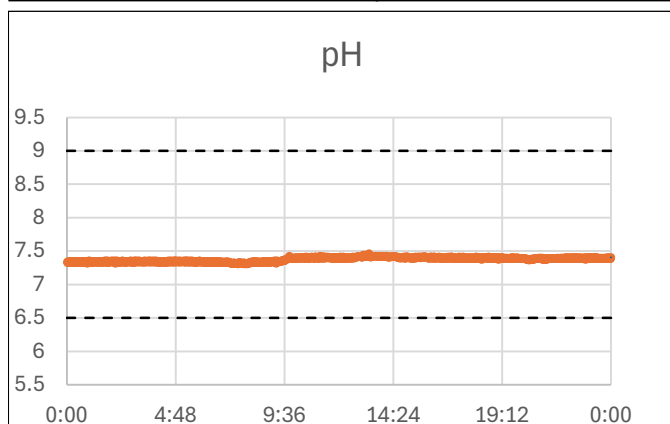

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	21°C	6.93	179 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	6 Gal	21 Gal	5 Gal
Vol. Remaining	287 Gal	110 Gal	35 Gal
Vol. Staged	0 Gal	255 Gal	125 Gal
Days Available	48 Days	18 Days	32 Days

Safety Issues/Concerns:

- N/A

Notes:

- Collected and Shipped Minepool and Table 1 Bi-Weekly Samples.
- Transferred 147 gallons of 50% NaOH.
- Batched 25 gallons of BaCl. Using the Permeate line to batch, This will cause flow to drop and pH too spike, still staying within Operating Permateres.