

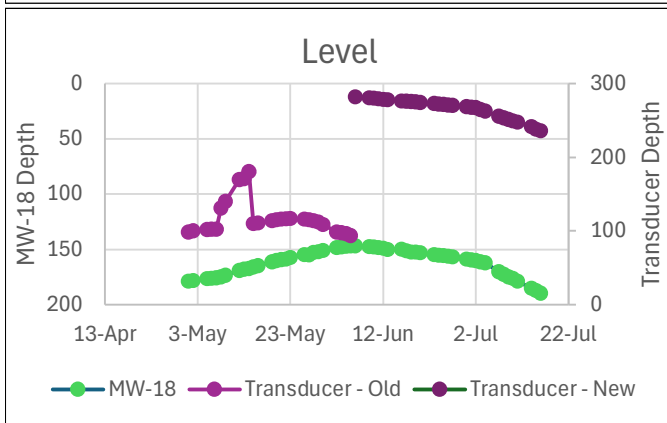


Schwartzwalder Daily Summary Report

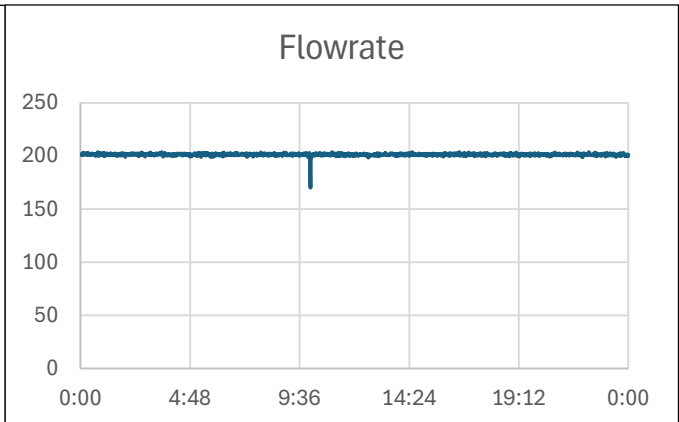

Report Date:	7/16/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.279 Mgal	MW-18 Level:	189.6 ft
Average Flowrate:	201.3 gpm	Transducer Level:	235.9 ft
Effluent to Date:	7.949 Mgal		

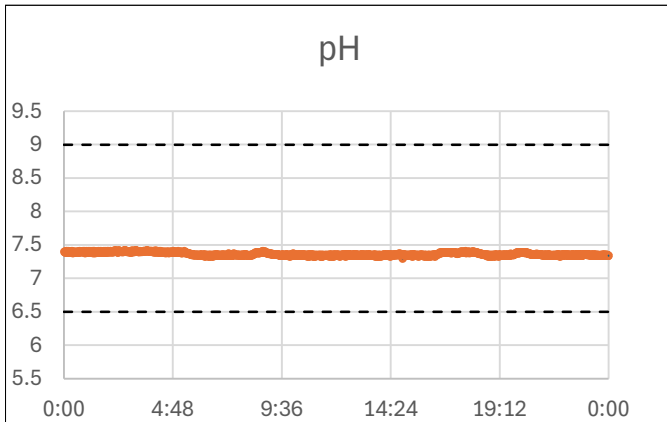

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	6.94	176 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	5 Gal	22 Gal	3 Gal
Vol. Remaining	281 Gal	237 Gal	50 Gal
Vol. Staged	0 Gal	255 Gal	125 Gal
Days Available	56 Days	22 Days	58 Days

Safety Issues/Concerns:

- N/A

Notes:

- Collected and Shipped Weekly TSS and COD Samples.
- Took a Mine Pool sample and verified readings with YSI Handheld. Used Permeate line to rinse the YSI. This caused a slight dip in the flow. Still within Operating Parameters.