

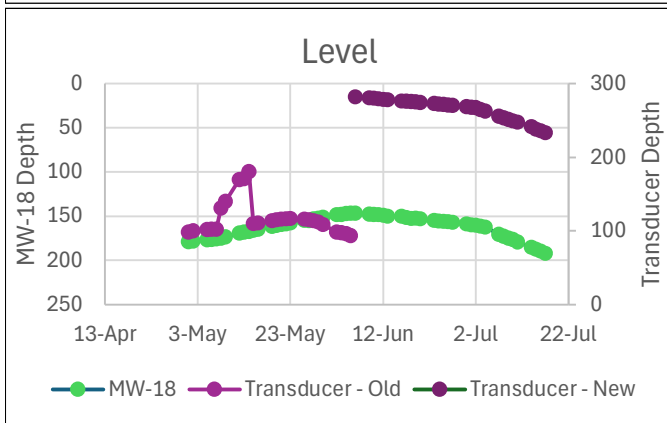


Schwartzwalder Daily Summary Report

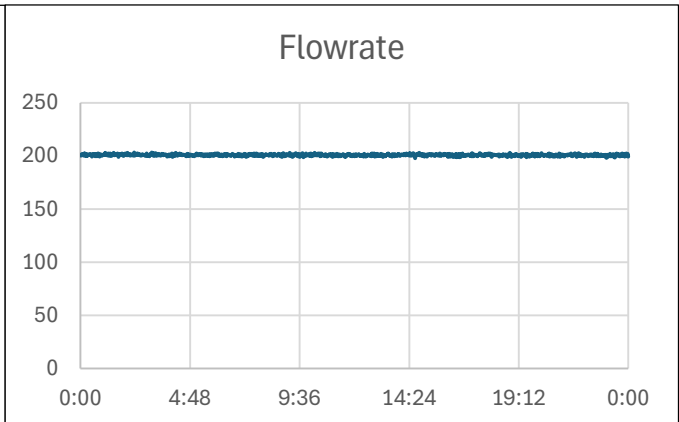

Report Date:	7/17/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.280 Mgal	MW-18 Level:	191.9 ft
Average Flowrate:	200.9 gpm	Transducer Level:	233.4 ft
Effluent to Date:	8.229 Mgal		

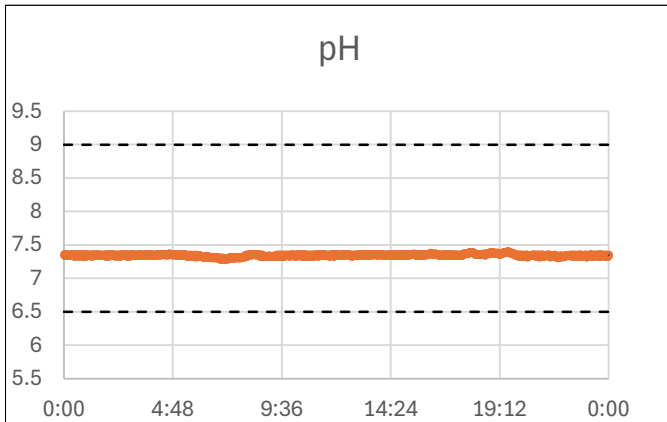

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	7.02	177 μ S/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	8 Gal	23 Gal	3 Gal
Vol. Remaining	276 Gal	215 Gal	47 Gal
Vol. Staged	0 Gal	255 Gal	125 Gal
Days Available	35 Days	21 Days	57 Days

Safety Issues/Concerns:

- N/A

Notes:

-