

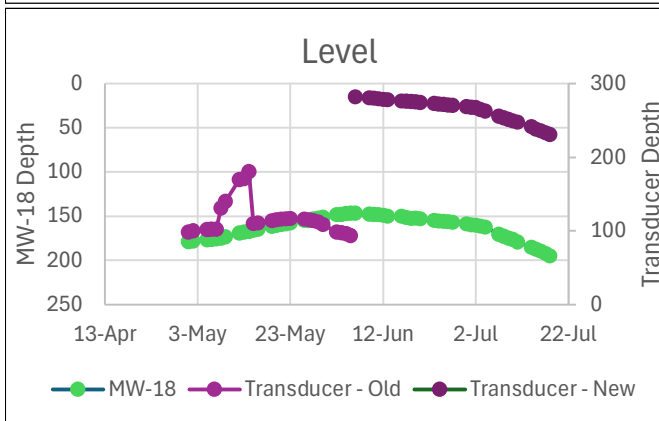


# Schwartzwalder Daily Summary Report

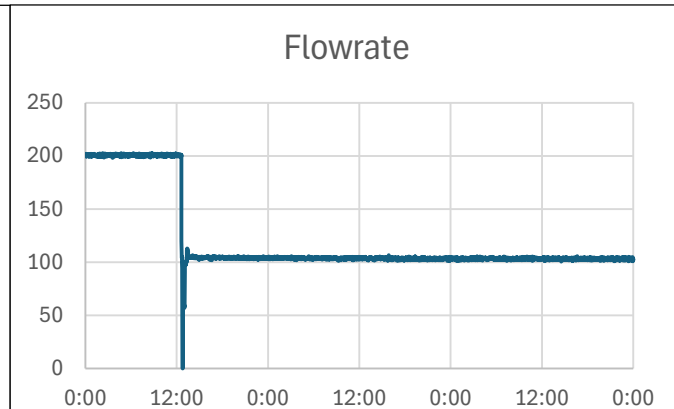

|              |           |                        |          |
|--------------|-----------|------------------------|----------|
| Report Date: | 7/18/2025 | Lead Operator:         | Chris P  |
|              |           | Assistant Operator(s): | Bryant A |

|                      |            |                   |          |
|----------------------|------------|-------------------|----------|
| Effluent Discharged: | 0.502 Mgal | MW-18 Level:      | 194.8 ft |
| Average Flowrate:    | 120.5 gpm  | Transducer Level: | 230.9 ft |
| Effluent to Date:    | 8.731 Mgal |                   |          |

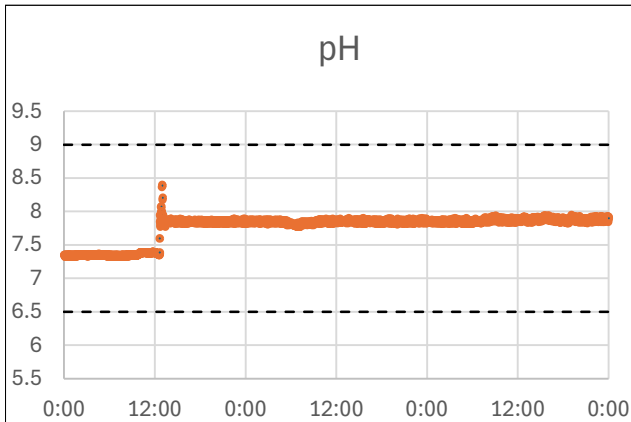

| Finished Water Quality |      |      |                |
|------------------------|------|------|----------------|
| Parameters             | Temp | pH   | Cond           |
| Values                 | 21°C | 7.41 | 176 $\mu$ S/cm |

| Chemical Inventory |             |         |         |
|--------------------|-------------|---------|---------|
| Chemicals          | Antiscalant | NaOH    | BaCl    |
| Vol. Used          | 3 Gal       | 41 Gal  | 14 Gal  |
| Vol. Remaining     | 268 Gal     | 192 Gal | 44 Gal  |
| Vol. Staged        | 0 Gal       | 255 Gal | 125 Gal |
| Days Available     | 89 Days     | 11 Days | 12 Days |

## Safety Issues/Concerns:

- N/A

## Notes:

- Collected Outfall 001A Weekly TSS Sample.
- RO#1 has been temporarily Shut Off. RO#1 Feed Pump is leaking. Arvada Pump expected onsite 7/24/25 to fix this issue.
- Flushed RO#1 with Permeate from RO#2. RO#2 running online by itself.