

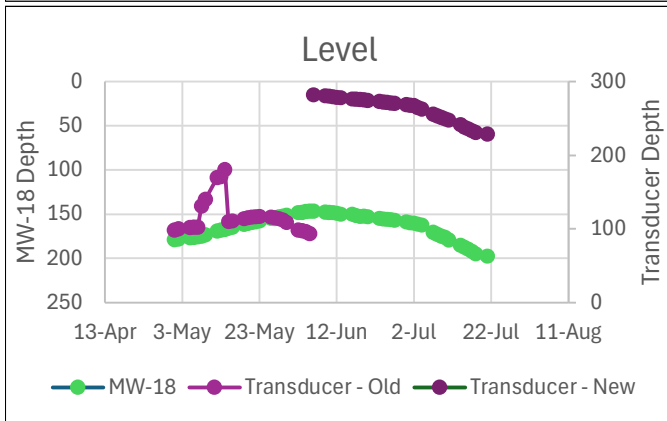


Schwartzwalder Daily Summary Report

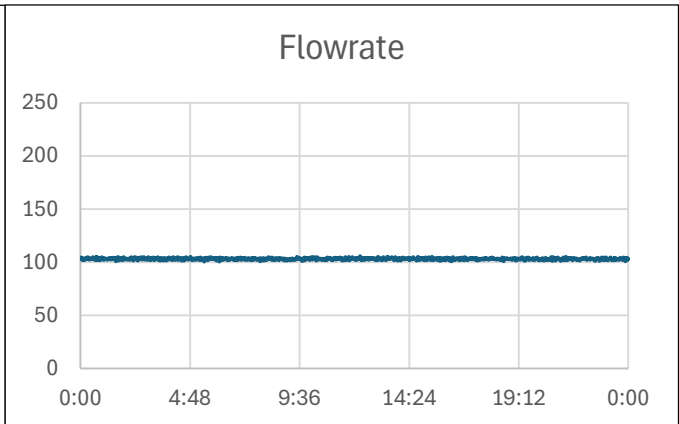

Report Date:	7/21/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.143 Mgal	MW-18 Level:	197.4 ft
Average Flowrate:	103.2 gpm	Transducer Level:	228.8 ft
Effluent to Date:	8.874 Mgal		

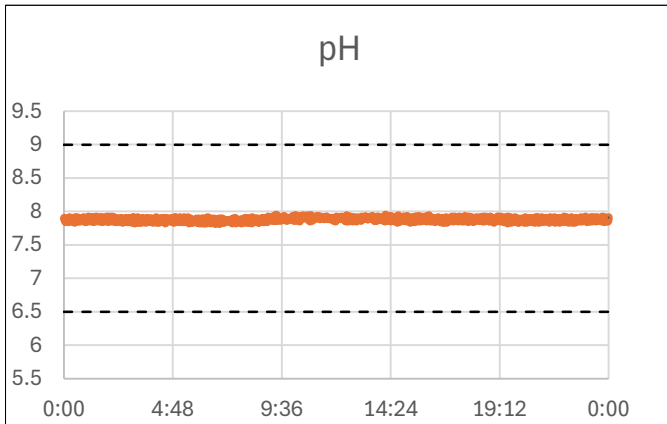

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	21°C	7.88	198 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	2 Gal	12 Gal	3 Gal
Vol. Remaining	266 Gal	150 Gal	30 Gal
Vol. Staged	0 Gal	255 Gal	125 Gal
Days Available	133 Days	34 Days	52 Days

Safety Issues/Concerns: - N/A
Notes: - Collected Outfall 001A Weekly TSS Sample. - Peter Hays onsite inspection.