

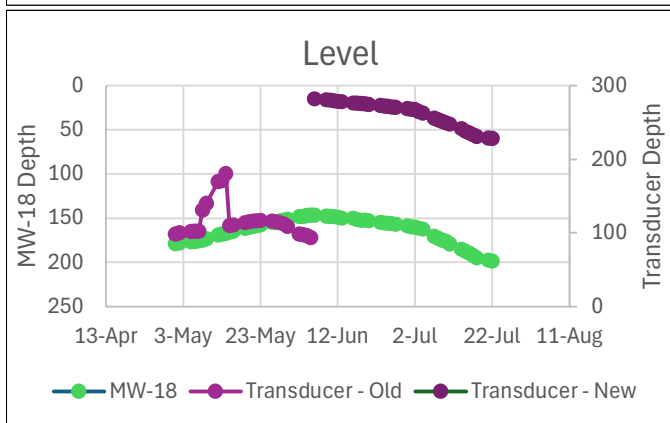


Schwartzwalder Daily Summary Report

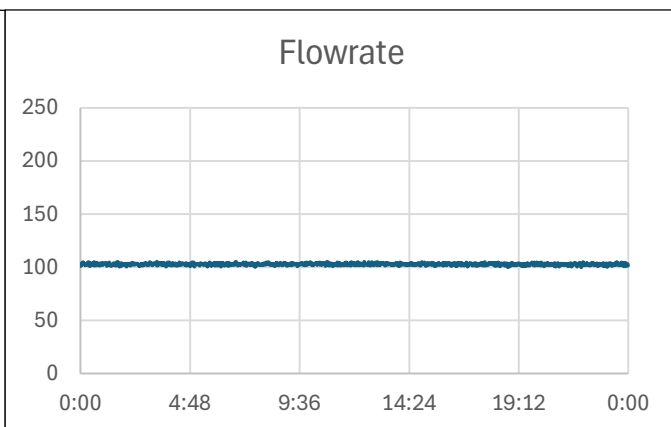

Report Date:	7/22/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.142 Mgal	MW-18 Level:	198.4 ft
Average Flowrate:	102.9 gpm	Transducer Level:	228.1 ft
Effluent to Date:	9.016 Mgal		

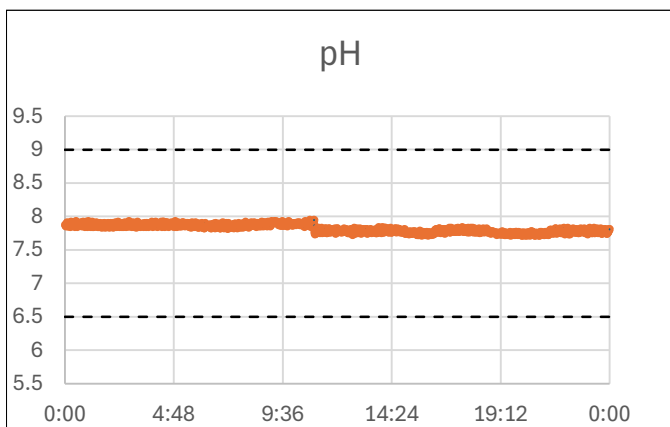

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	21°C	7.56	198 μ S/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	2 Gal	11 Gal	4 Gal
Vol. Remaining	264 Gal	138 Gal	27 Gal
Vol. Staged	0 Gal	255 Gal	125 Gal
Days Available	132 Days	36 Days	38 Days

Safety Issues/Concerns:

- N/A

Notes:

- Collected and Shipped Table 1 Bi-Weekly Samples.
- Lowered dosage of BaCl and NaOH.