

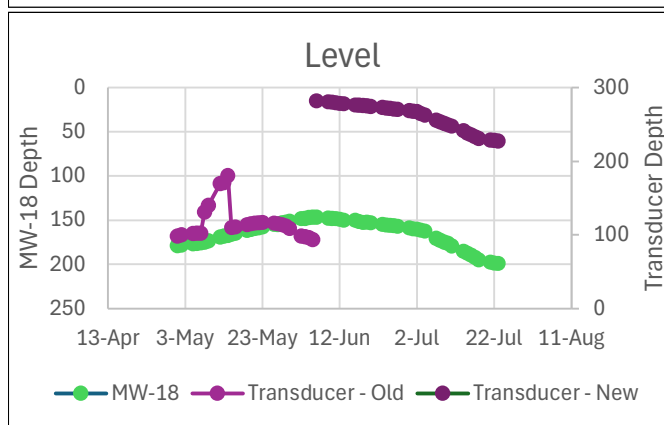


Schwartzwalder Daily Summary Report

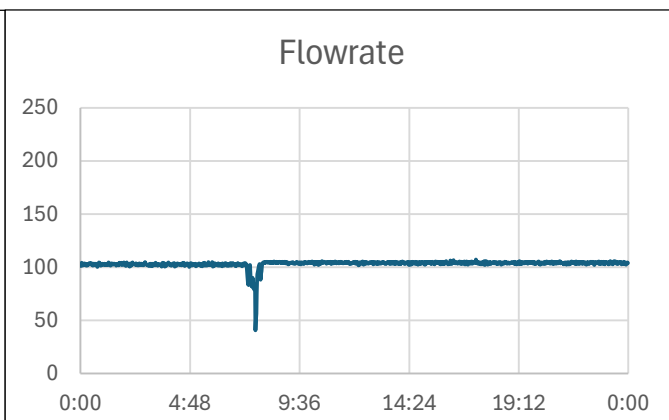

Report Date:	7/23/2025	Lead Operator:	Chris P
		Assistant Operator(s):	Bryant A
Effluent Discharged:	0.143 Mgal	MW-18 Level:	198.8 ft
Average Flowrate:	103.3 gpm	Transducer Level:	227.4 ft
Effluent to Date:	9.159 Mgal		

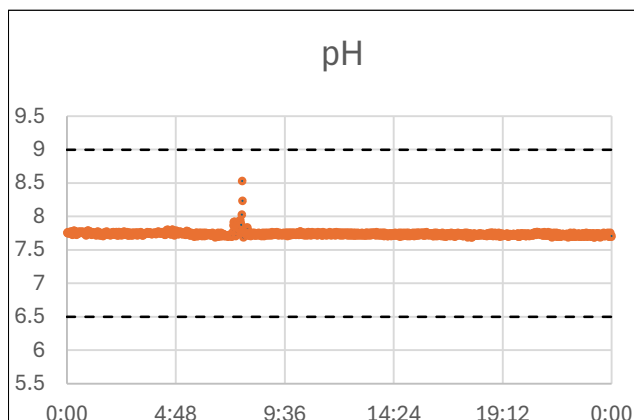

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	7.95	195 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	2 Gal	12 Gal	2 Gal
Vol. Remaining	262 Gal	127 Gal	50 Gal
Vol. Staged	0 Gal	255 Gal	100 Gal
Days Available	131 Days	32 Days	75 Days

Safety Issues/Concerns:

- N/A

Notes:

- Collected and Shipped TSS and COD Weekly Samples.
- Flushed and drained RO#1 with RO#2 Permeate. Prepped area for RO#1 Feed Pump Maintenance.
- Batched 25 gallons of BaCl using RO#2 Permeate. This caused flow to drop and pH too spike. Still within operating parameters.