

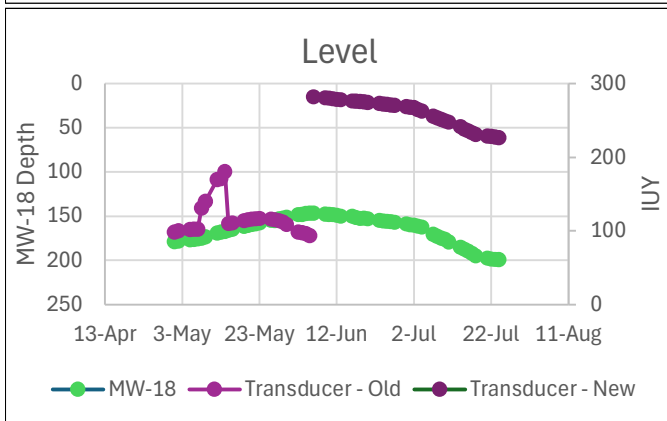


Schwartzwalder Daily Summary Report

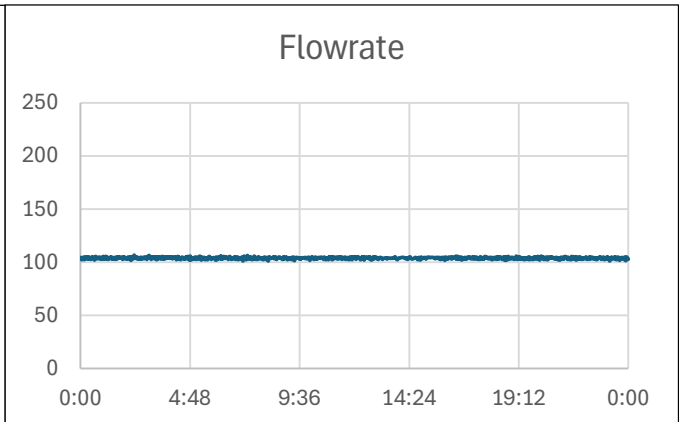

Report Date:	7/24/2025	Lead Operator:	Patrick D
		Assistant Operator(s):	Bryant A

Effluent Discharged:	0.130 Mgal	MW-18 Level:	199.3 ft
Average Flowrate:	104.0 gpm	Transducer Level:	226.7 ft
Effluent to Date:	9.289 Mgal		

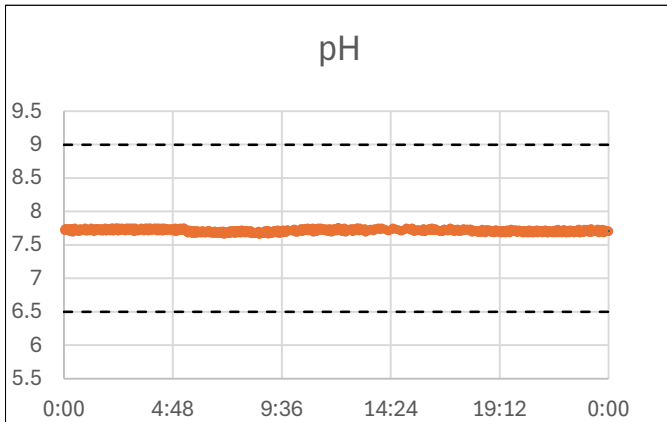

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	7.74	198 μ S/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	3 Gal	12 Gal	2 Gal
Vol. Remaining	260 Gal	115 Gal	48 Gal
Vol. Staged	0 Gal	255 Gal	100 Gal
Days Available	87 Days	30 Days	74 Days

Safety Issues/Concerns:

- N/A

Notes:

- Arvada Pump Company onsite to inspect pump and determine work that will need to be done on RO#1 Feed Pump.
- Anti scalant delivery 2 Totes. Total of 460 gallons.
- Starlink was down from 13:03 to 15:25.