

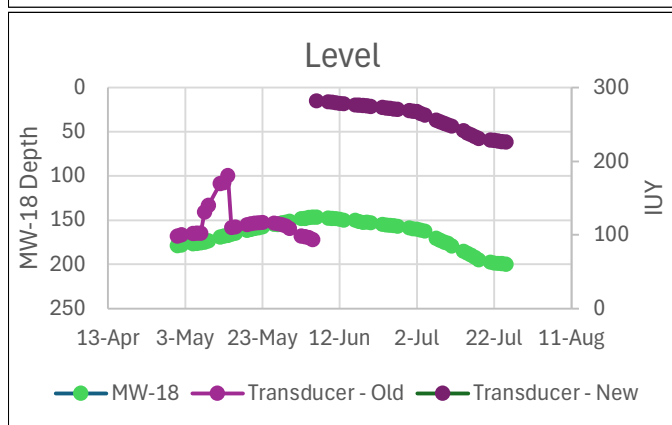


Schwartzwalder Daily Summary Report

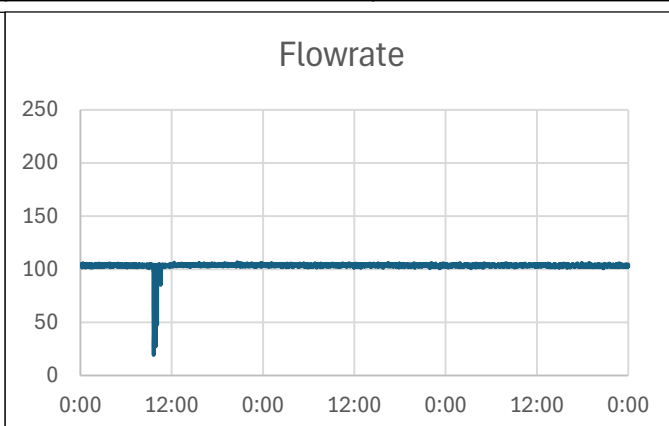

Report Date:	7/25/2025	Lead Operator:	Patrick D
		Assistant Operator(s):	Bryant A
Effluent Discharged:	0.432 Mgal	MW-18 Level:	199.7 ft
Average Flowrate:	103.5 gpm	Transducer Level:	225.9 ft
Effluent to Date:	9.721 Mgal		

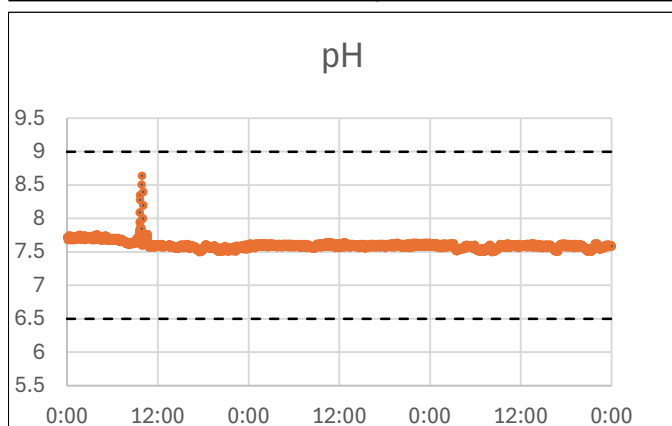

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	7.65	199 µS/cm
Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	8 Gal	29 Gal	4 Gal
Vol. Remaining	257 Gal	103 Gal	47 Gal
Vol. Staged	460 Gal	135 Gal	100 Gal
Days Available	90 Days	8 Days	37 Days

Safety Issues/Concerns:

- N/A

Notes:

- Trasferred 129 gallons of 50% NaOH.
- Washed NaOH Tote with RO#2 Permeate. This caused pH to spike and Flow to drop. Still within Operating Parameters.
- Collected Outfall 001A Weekly TSS Sample.
- Raised Plant Feed Pump Hertz from 46.8Hz to 46.9Hz.