

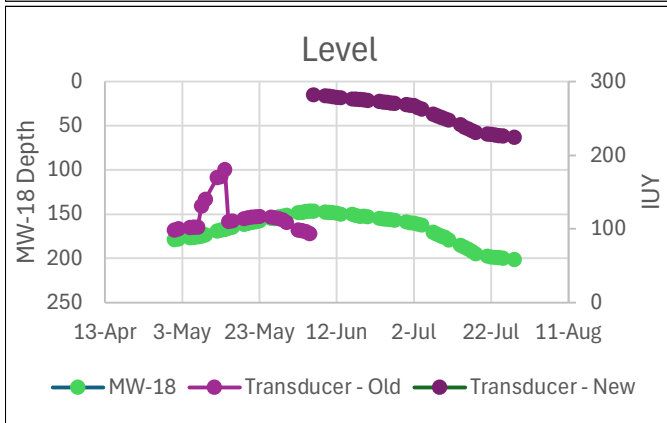


Schwartzwalder Daily Summary Report

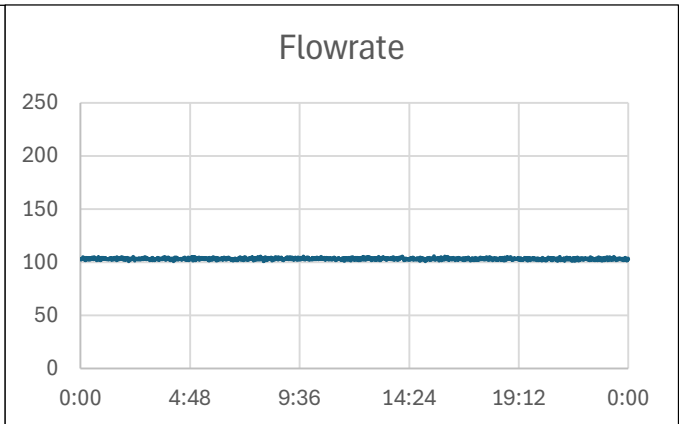

Report Date:	7/28/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.143 Mgal	MW-18 Level:	201.1 ft
Average Flowrate:	103.3 gpm	Transducer Level:	224.5 ft
Effluent to Date:	9.864 Mgal		

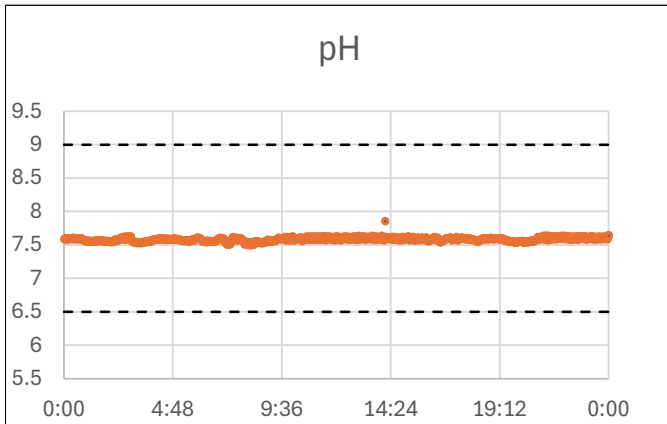

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	21°C	7.48	200 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	3 Gal	11 Gal	2 Gal
Vol. Remaining	249 Gal	221 Gal	42 Gal
Vol. Staged	460 Gal	135 Gal	100 Gal
Days Available	236 Days	31 Days	71 Days

Safety Issues/Concerns:
- N/A

Notes:
-Collected Outfall 001A Weekly TSS Sample.