

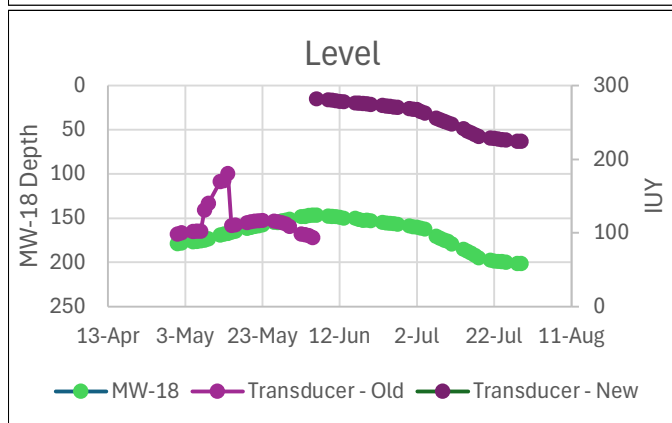


Schwartzwalder Daily Summary Report

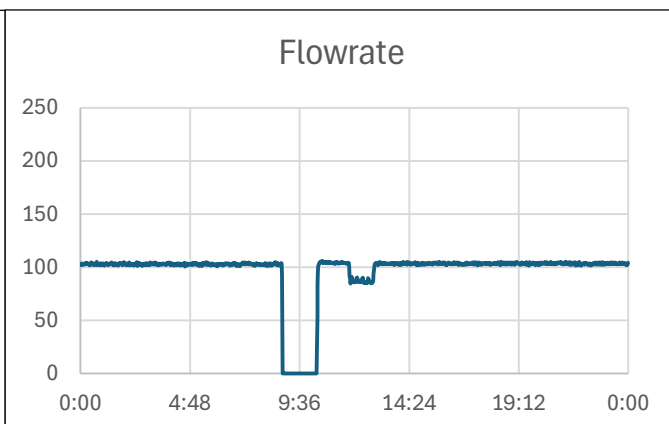

Report Date:	7/29/2025	Lead Operator:	Patrick D
		Assistant Operator(s):	Bryant A
Effluent Discharged:	0.133 Mgal	MW-18 Level:	201.4 ft
Average Flowrate:	95.9 gpm	Transducer Level:	224.2 ft
Effluent to Date:	9.997 Mgal		

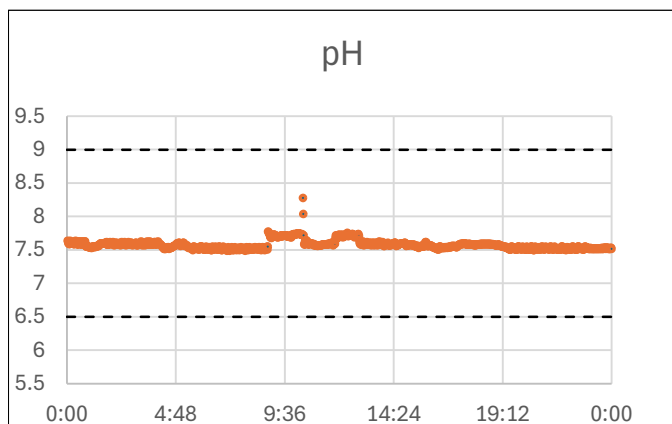

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	6.93	192 μ S/cm
Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	3 Gal	12 Gal	4 Gal
Vol. Remaining	246 Gal	210 Gal	40 Gal
Vol. Staged	460 Gal	135 Gal	100 Gal
Days Available	235 Days	29 Days	35 Days

Safety Issues/Concerns:

- N/A

Notes:

- Plant Shut-Down at 08:49.
- Replaced bleed off valves on 3 RO Canisters. Replaced 2 from RO#1 and 1 from RO#2.
- Replaced RO#2 Anti Scalant valve at injection point.
- Plant Start-Up at 10:20.
- Flushed and Drained RO#1 using RO#2 Permeate.







