

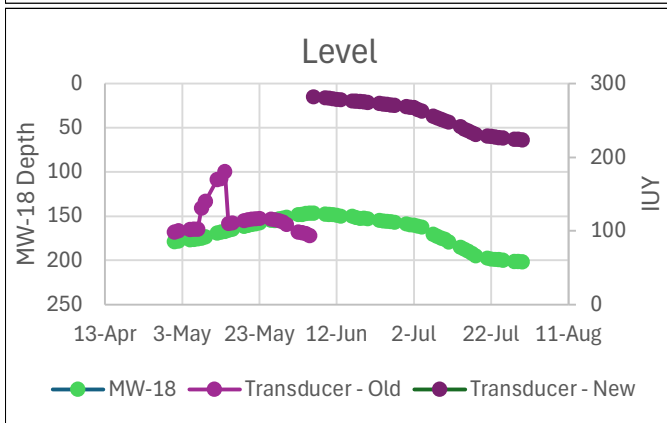


Schwartzwalder Daily Summary Report

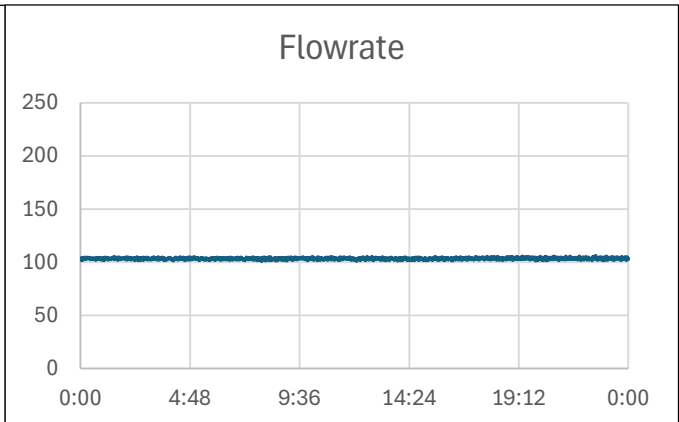

Report Date:	7/30/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.143 Mgal	MW-18 Level:	201.7 ft
Average Flowrate:	103.5 gpm	Transducer Level:	223.7 ft
Effluent to Date:	10.140 Mgal		

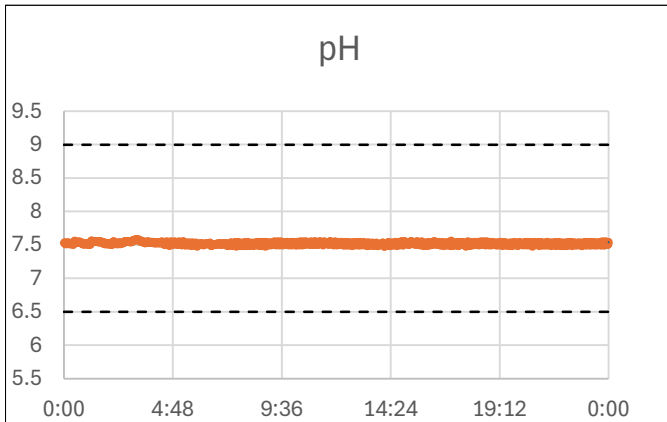

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	21°C	8.04	188 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	3 Gal	11 Gal	6 Gal
Vol. Remaining	242 Gal	198 Gal	36 Gal
Vol. Staged	460 Gal	135 Gal	100 Gal
Days Available	234 Days	31 Days	23 Days

Safety Issues/Concerns:

- N/A

Notes:

- Collected and Shipped Outfall 001A Weekly TSS, COD and Quarterly TDS Samples.