

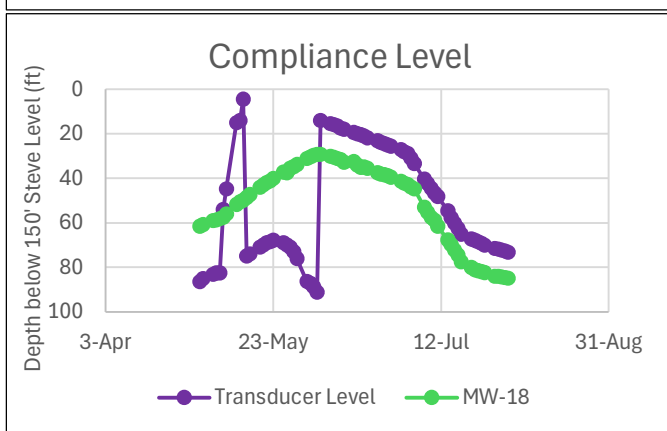


# Schwartzwalder Daily Summary Report

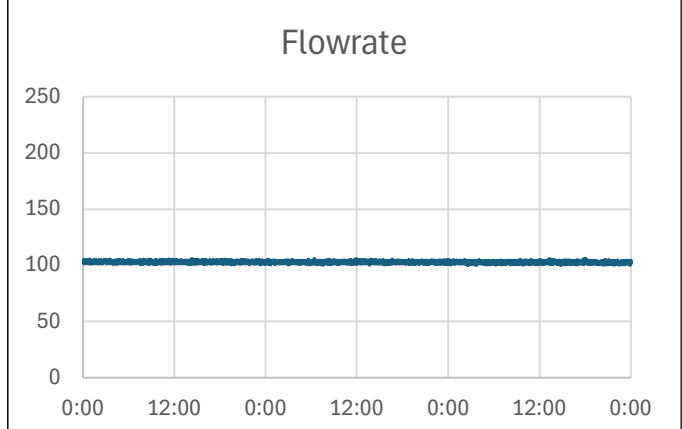

Report Date:	8/1/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.430 Mgal	MW-18 Level:	202.3 ft	85.0 ft
Average Flowrate:	103.0 gpm	Transducer Level:	222.8 ft	73.2 ft
Effluent to Date:	10.714 Mgal	(Field Reading   Value below 150')		

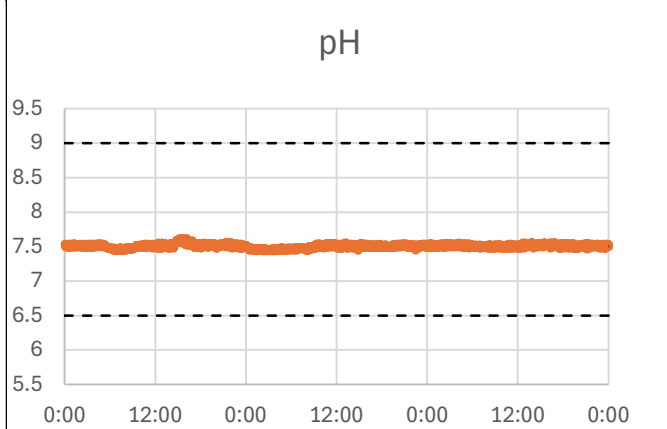

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	7.67	189 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	10 Gal	32 Gal	8 Gal
Vol. Remaining	236 Gal	176 Gal	50 Gal
Vol. Staged	460 Gal	135 Gal	80 Gal
Days Available	70 Days	10 Days	16 Days

**Safety Issues/Concerns:**  
- N/A

**Notes:**  
- Collected Outfall 001A Weekly TSS Sample.

NOTE: The level graph has been adjusted to show field readings relative to the water level below the compliance elevation (150' below the Steve Adit - 6459' ASL). Data from 5/1/2025 to 6/5/2025 was recorded using an atmospheric transducer with a 500-ft cable, installed at the end of the 2024 season and remained in place over the winter. On 6/6/2025, it was replaced with an absolute transducer with a 600-ft cable at a lower depth. A 77.1-ft difference in readings was observed. While some of offset may be a result from the deeper installation and transducer type, the old data's accuracy is questionable due to damage to the atmospheric vent, which may have allowed moisture intrusion.