

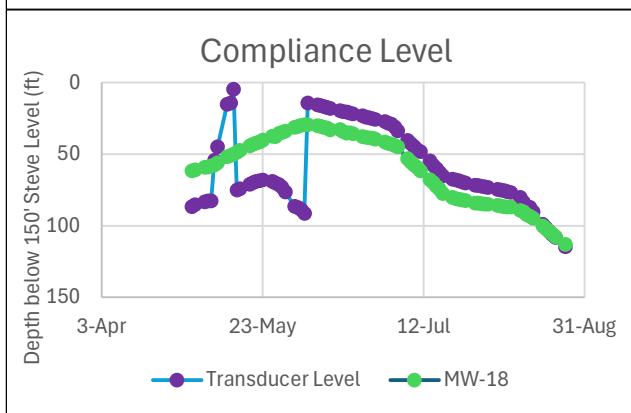


Schwartzwalder Daily Summary Report

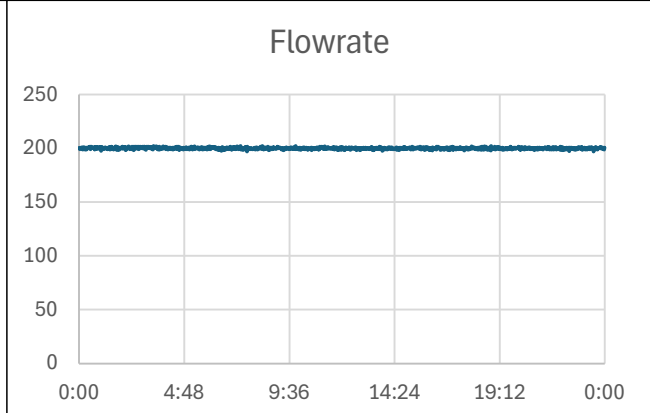

Report Date:	8/25/2025	Lead Operator:	Bryant A
		Assistant Operator(s):	

Effluent Discharged:	0.279 Mgal	MW-18 Level:	230.2 ft	112.8 ft
Average Flowrate:	200.4 gpm	Transducer Level:	181.4 ft	114.6 ft
Effluent to Date:	15.978 Mgal	(Field Reading Value below 150')		

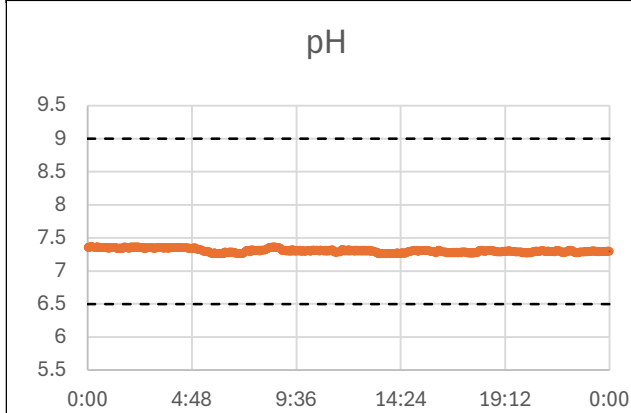

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	6.72	171 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	6 Gal	21 Gal	4 Gal
Vol. Remaining	318 Gal	149 Gal	43 Gal
Vol. Staged	230 Gal	770 Gal	400 Gal
Days Available	91 Days	43 Days	111 Days

Safety Issues/Concerns:
- N/A

Notes:
- Collected Outfall 001A Weekly TSS Sample.