

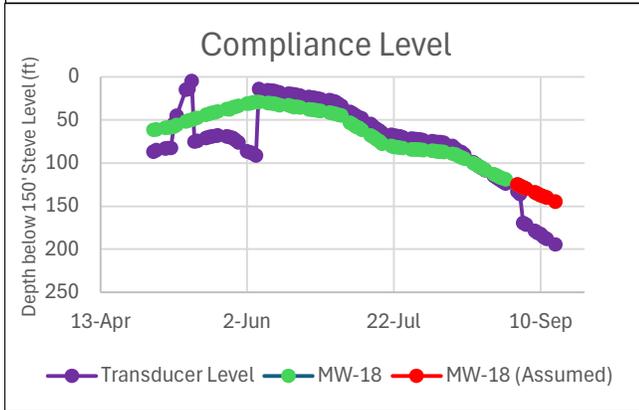


Schwartzwalder Daily Summary Report

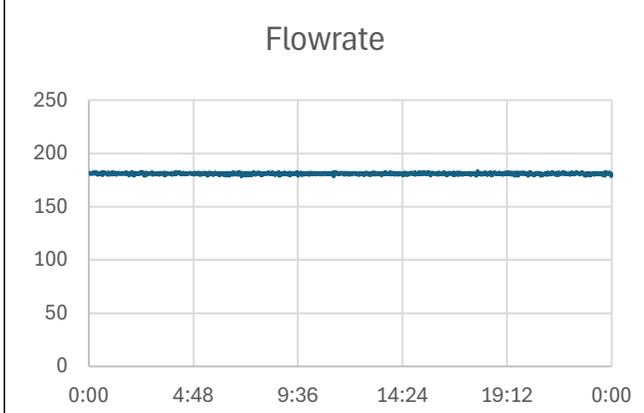

Report Date:	9/15/2025	Lead Operator:	Patrick D
		Assistant Operator(s):	

Effluent Discharged:	0.252 Mgal	MW-18 Level:	261.9 ft	144.6 ft
Average Flowrate:	180.9 gpm	Transducer Level:	101.7 ft	194.3 ft
Effluent to Date:	21.723 Mgal	(Field Reading Value below 150')		

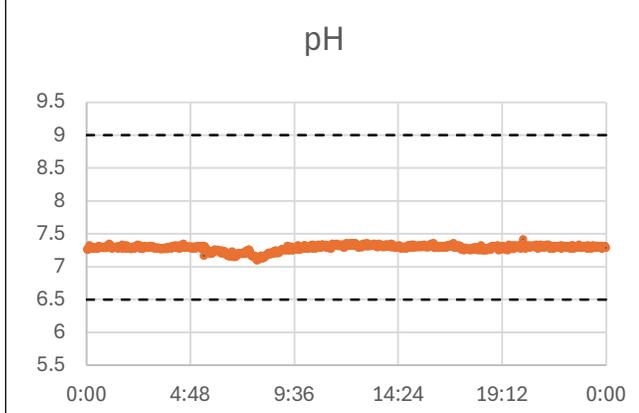

Finished Water Quality			
Parameters	Temp	pH	Cond
Values	20°C	7.32	200 µS/cm

Chemical Inventory			
Chemicals	Antiscalant	NaOH	BaCl
Vol. Used	7 Gal	23 Gal	3 Gal
Vol. Remaining	399 Gal	168 Gal	40 Gal
Vol. Staged	0 Gal	270 Gal	300 Gal
Days Available	57 Days	19 Days	113 Days

Safety Issues/Concerns:
- N/A

Notes:
- PLC work continued. Confirmed that spare parts can be put into one PLC to replace the old RO PLC.
- Tested and confirmed Auto Sampler. Adjusted settings for TSS Samples.
- Collected Outfall 001A TSS sample.

NOTE: For the level graph, Data from 5/1/2025 to 6/5/2025 was recorded using an atmospheric transducer with a 500-ft cable, installed at the end of the 2024 season. On 6/6/2025, it was replaced with an absolute transducer with a 600-ft cable (lower depth). A 77.1-ft difference in readings was observed. MW-18 ran dry effective 9/2/2025. Assume a decline of 1.5125 ft per day for the projected MW-18 depth effective 9/2/2025. On 9/4/2025, the transducer was temporarily removed from the casing to verify the minepool water depth. The transducer was recalibrated to align with the field readings resulting in a difference of 30.4 ft lower than previously indicated.