



COLORADO

Division of Water Resources

Department of Natural Resources

Board of Examiners of Water Well Construction
and Pump Installation Contractors

REVOKE JANUARY 1, 2026; SCROLL DOWN FOR ADDITIONAL INFORMATION

May 3, 2021

Policy 2021-2

WELLS CONSTRUCTED IN THE ALLUVIAL, OGALLALA, AND WHITE RIVER AQUIFERS INSIDE THE NORTHERN HIGH PLAINS DESIGNATED BASIN

Background

The term "alluvium" is used to describe the sediments deposited by modern streams during relatively recent time. The same processes that transport and deposit sediments in Colorado's stream valleys today have deposited "alluvial" sediments for millions of years and have been a primary means for basin filling since the uplift of the Rocky Mountains some 65 million years ago. Much of the older sedimentary rock deposited prior to that time is associated with deposition in shallow seas (marine sediments).

Thus, fluvial (river/stream) processes have resulted in the deposition of thousands of feet of clay, silt, sand, and gravel (alluvial sediments) in the intermontane and foreland basins of Colorado. Because the sediments were transported and deposited by streams, they are all considered to be "alluvial" deposits. With time and depending on conditions in the subsurface, alluvial deposits become consolidated to semi-consolidated (lithified - cemented by chemical processes, or simply compacted). The lithification process is evident in the conglomerates, sandstones, siltstones, and claystones that comprise the Arapahoe, Denver, and Dawson aquifers of the foreland Denver Basin, the Troublesome and North Park formations of the North and Middle Park intermontane basins, and the White River Formation of the eastern plains. These deposits are considered to be "bedrock", based on their relative age, not their degree of induration or lithification. Likewise, the Ogallala Formation, which is compacted but may be unconsolidated in many locations, is a fluvial deposit of ancient alluvium, but is considered bedrock. It is this difference of the clastic materials of the Ogallala Formation from modern river depositional systems that places it in the Type II aquifer category.

The treatment of the Ogallala Formation as a Type II aquifer by the Board of Examiners is not new with this policy. It is discussed within [BOE Policy 2003-3, Construction Standards for Wells in the Unconfined Sediments of the Alamosa Formation in the San Luis Valley](#), that the Ogallala of eastern Colorado should be treated as a Type II aquifer, not a Type III aquifer. This policy reiterates this standard in a separate policy specifically for the Northern High Plains.

In the Rules and Regulations for the Management and Control of Designated Groundwater (Designated Basin Rules) (2 CCR 410-1, 1/14/2020), designated groundwater in the Northern High Plains Designated Groundwater Basin (Figure 1) includes the Ogallala and White River bedrock aquifers together. The Division of Water Resources (DWR) will henceforth label the Ogallala and



White River aquifers together as the “High Plains Aquifer” within the Northern High Plains Designated Basin. Historical aquifer names will not be changed in the DWR databases, but High Plains Aquifer will be used on well permits and well construction reports moving forward.

Era	System	Series	Stratigraphic unit	Hydrogeologic unit	Physical characteristics
Cenozoic	Quaternary	Holocene and Pleistocene	Alluvial deposits, valley-fill deposits and dune sand	Type 3	Gravel, sand, silt, and clay
			Ogallala Formation	High Plains aquifer	Unconsolidated, poorly sorted gravel, sand, silt, and clay
	Tertiary	Upper Miocene	Arikaree Formation		Sandstone, fine to very fine. Local beds of volcanic ash, siltstone, claystone, and marl
			Brule Formation	Type 2	Siltstone with sandstone as beds and channel deposits
		Lower Oligocene	Chadron Formation		Clay and silt
Modified from Gutentag and others, 1984					

Aquifer Types in Northern High Plains Designated Groundwater Basin

Rule 10.4.6 in the Well Construction Rules (Rules) (2 CCR 402-2, 9/1/2016) requires wells completed in a Type II aquifer (unconfined bedrock aquifer) to have at least 40 feet of solid casing and 30 feet of continuous grout, with the uppermost 20 feet of casing being steel.

Rule 10.4.6.3 provides that in the event the unconfined bedrock aquifer (Type II) is overlain by an unconsolidated aquifer (Type III), the unconsolidated aquifer must be fully isolated with grout or driven steel casing. In the Northern High Plains, wells constructed into the High Plains Aquifer can also produce water from the overlying alluvium because the Alluvial, Ogallala, and White River aquifers are administered as a single hydrogeologic unit, so Rule 10.4.6.3 is not applicable.

Wells constructed to solely produce from the modern alluvial aquifer (Type III wells) must be constructed pursuant to Rule 10.4.7.

Policy

In order to provide consistency and adequacy in the construction of water wells within the High Plains Aquifer of the Northern High Plains Designated Groundwater Basin, and to acknowledge that these wells may produce water from the Alluvial, Ogallala and White River aquifers which are administered as a single hydrogeologic unit, the Board hereby adopts the following policy:

Water wells constructed within the High Plains Aquifer of the Northern High Plains Designated Groundwater Basin must be constructed in accordance with the construction standards for Type II aquifers (unconfined bedrock) found in Rule 10.4.6. This policy does not supersede any construction requirements specified in the conditions of approval of a valid well permit. Any deviation from the requirements of Rules 10.4.6, 10.4.6.1, or 10.4.6.2 or other applicable standards of the Water Well Construction Rules must comply with the requirements of Rule 18, Variances.

Approval

This policy may only be modified or revoked in writing by the Board of Examiners of Water Well Construction and Pump Installation Contractors.

Approved May 3, 2021


_____,

Keith Branstetter, Chairperson
Board of Examiners of Water Well Construction
and Pump Installation Contractors

Map Key




Northern High Plains Designated Basin



High Plains Aquifer



0 10 20 Miles

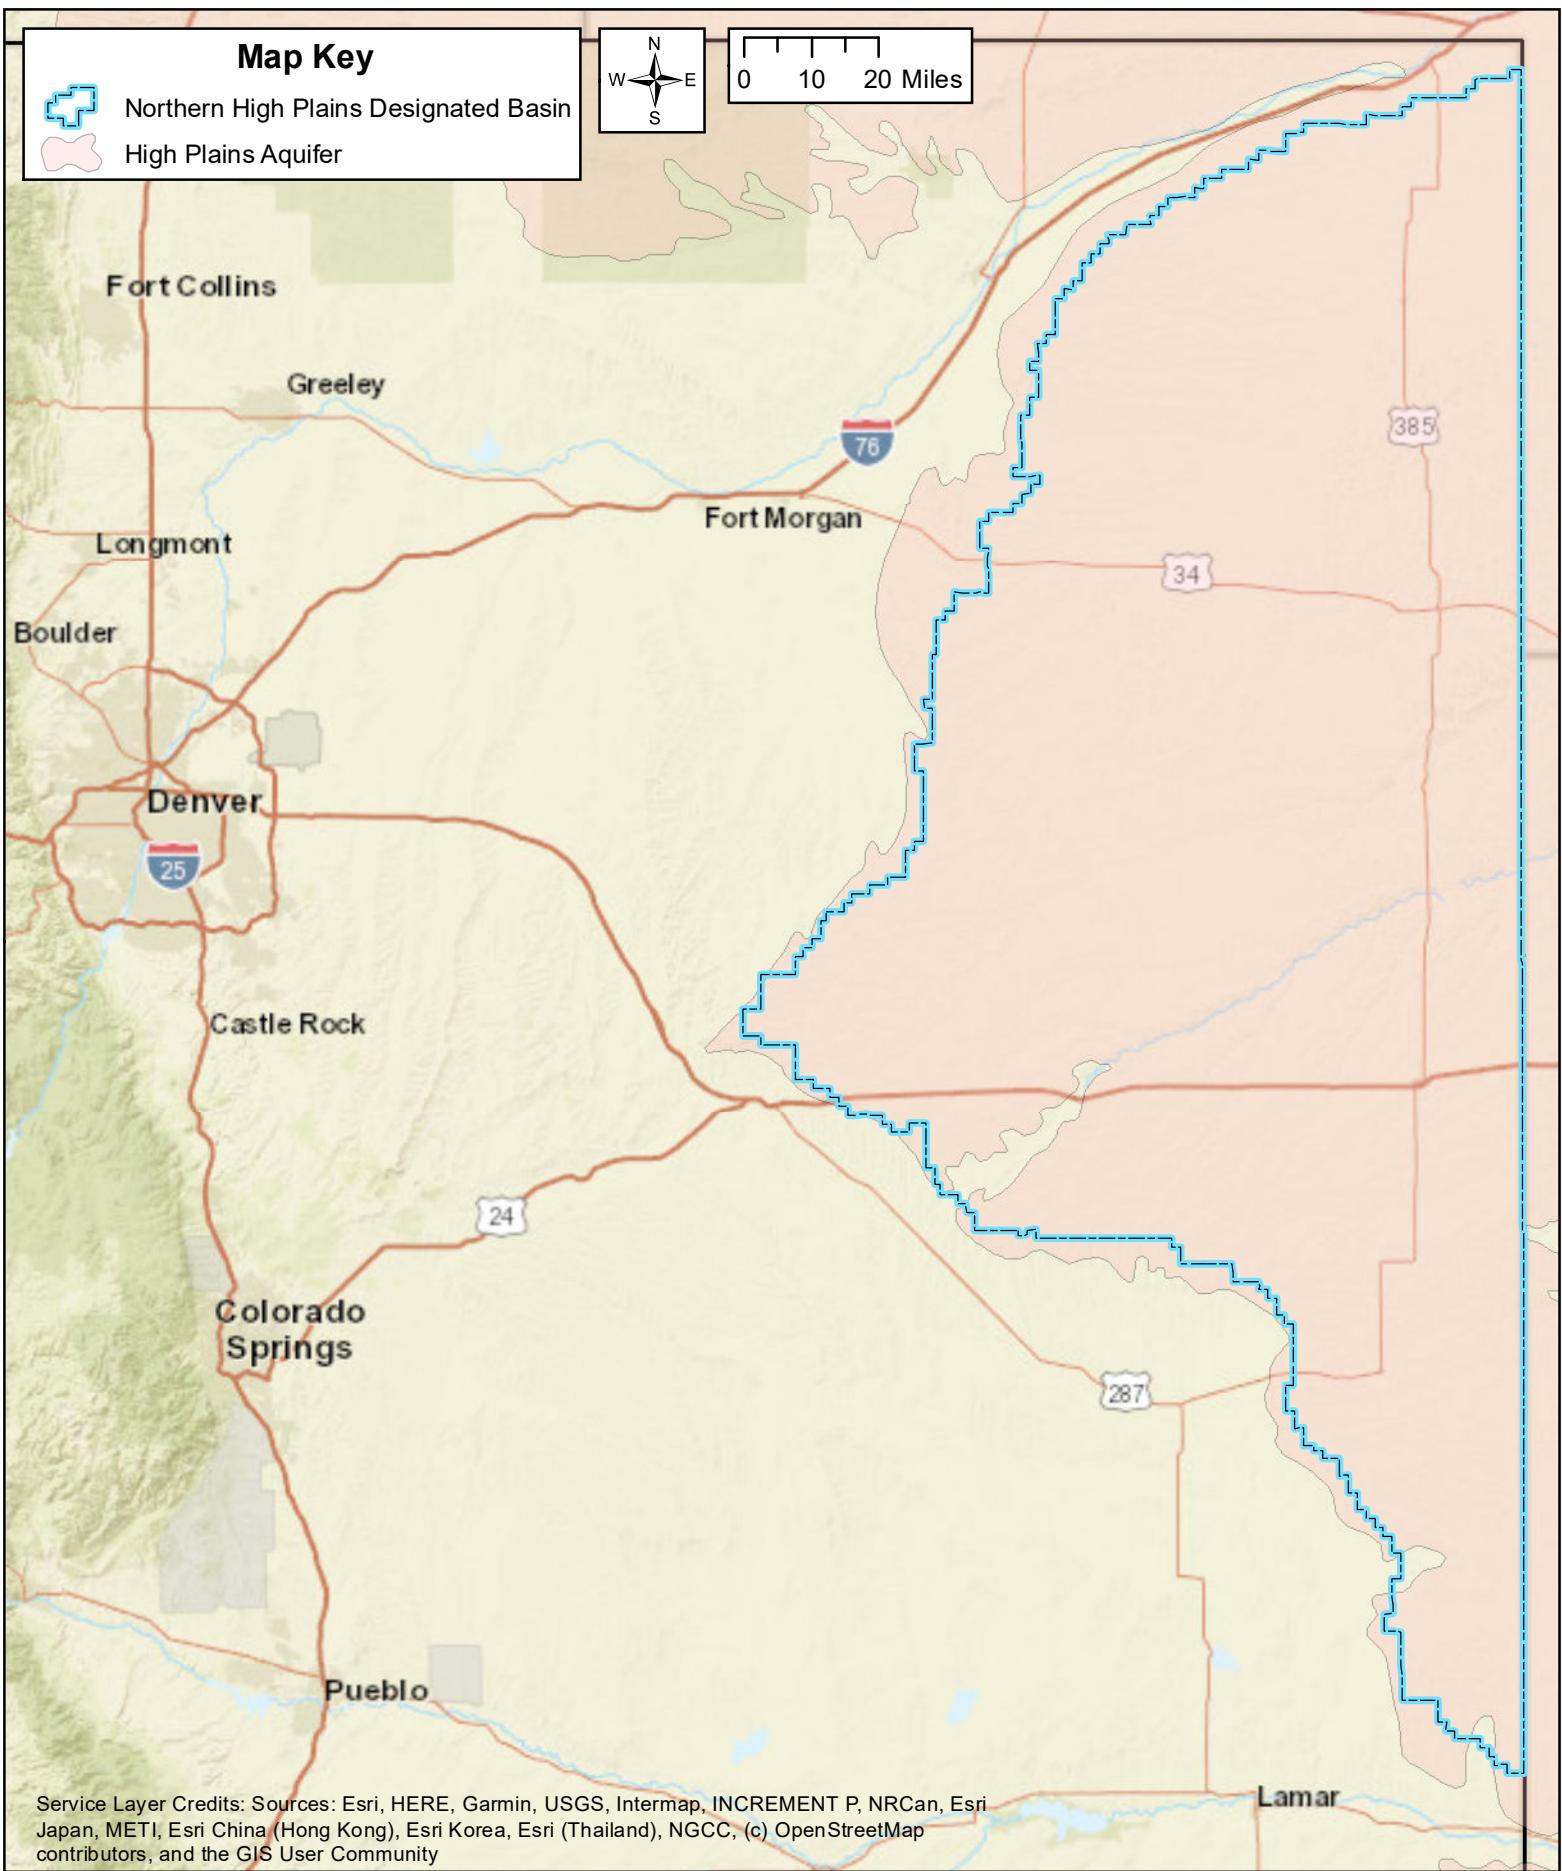

Service Layer Credits: Sources: Esri, HERE, Garmin, USGS, Intermap, INCREMENT P, NRCan, Esri Japan, METI, Esri China (Hong Kong), Esri Korea, Esri (Thailand), NGCC, (c) OpenStreetMap contributors, and the GIS User Community



COLORADO

Division of Water Resources

Department of Natural Resources

**Northern High Plains
Designated Groundwater Basin**

**Figure
1**



COLORADO
Division of Water Resources

Department of Natural Resources

Board of Examiners of Water Well and
Ground Heat Exchanger Contractors

**Policies Revoked by the Board
following the implementation of the 2026 Well Construction Rules**

The Well Construction Rules were amended in May 2025 and have an effective date of January 1, 2026. Following the implementation of the 2026 Rules, several Policies will no longer be applicable because they have been incorporated into or addressed in the new Rules.

Policies revoked by the Board upon effective date of the Rules:

- [2003-3: Construction Standards for Wells in the Unconfined Sediments of the Alamosa Formation in the San Luis Valley](#)
 - 2026 Rules cover under Rule 5.2.3.6
- [2016-1: Board Approval of Chemicals Used in Well Development and Rehabilitation](#)
 - 2026 Rules cover under Rule 6.10.3
- [2017-2: Wells Constructed into Type 1 Aquifers \(Confined\) Overlain by a Type 3 Aquifer \(Alluvial/Colluvial\)](#)
 - 2026 Rules cover under Rule 10.4.5
- [2017-3: Wells Constructed into Type 2 Aquifers within the Boundaries of the Southern High Plains Designated Basin](#)
 - 2026 Rules cover under Rule 5.2.3.9
- [2018-2: Clarification of Rule 16.2, Grouting Requirement for Type 1 Aquifer Well Abandonment](#)
 - 2026 Rules cover under Rule 16.2.1
- [2021-2: Wells Constructed in the Alluvial, Ogallala, and White River Aquifers Inside the Northern High Plains Designated Basin](#)
 - 2026 Rules cover under Rule 5.2.3.8
- [2023-1: Portland-Limestone Cement \(ASTM C-595, Type IL\) as Replacement for Portland Cement \(ASTM C-150\)](#)
 - 2026 Rules cover under Rule 10.5 and Table 2
- [2025-1: Grouting of Wells With Driven Surface Casing](#)
 - 2026 Rules cover under Rule 10.4.2.1

The above listed Board Policies are hereby revoked by the Board, effective January 1, 2026.

Approved December 2, 2025

Christopher J. Sanchez, P.G., Chair
Board of Examiners of Water Well and
Ground Heat Exchanger Contractors

